


Commercial Standard-Efficiency Condensing Units



R-410A
earth friendly refrigerant

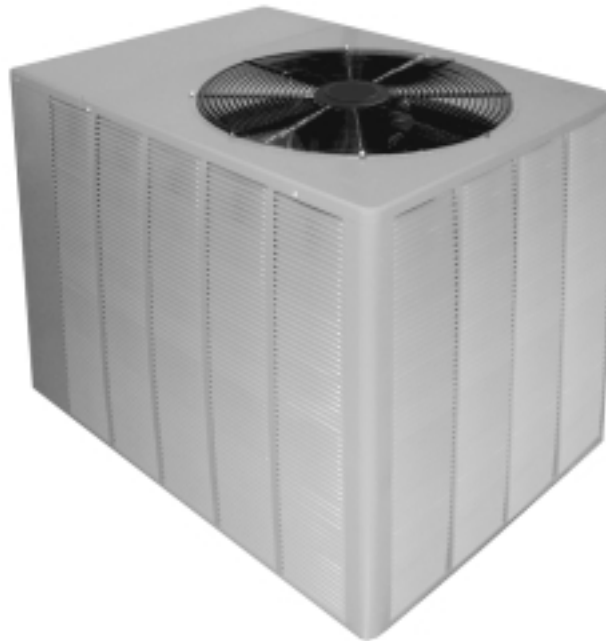

SAWL—Standard Efficiency

**6.5 & 7.5 TON MODEL
[22.86 & 26.38 kW]**

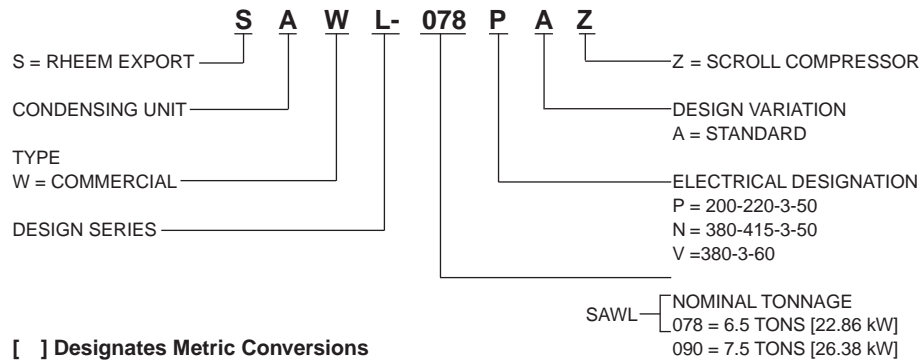


TABLE OF CONTENTS

Model Number Designation.....	2
Accessories & Standard Unit Features	3
Selection Procedure	
Matched Systems	4
Gross Capacity and Power Tables	5
Unit Dimensions	6
ARI Ratings	7

Electrical & Physical Data Table	8
Cooling Performance Data	9-17
Piping	18-19
Installation	19
Wiring Schematic	20-21
Guide Specifications	22

MODEL IDENTIFICATION



CONDENSING UNIT ACCESSORIES

ACCESSORY DESCRIPTION	MODEL NUMBER	SIZES USED ON
Anti-Short Cycle Timer Kit	RXAT-A01	SAWL-078, 090
Sight Glass	RXAG-A048	SAWL-078, 090
Liquid Line Solenoid Valve*	RXAV-BD048	SAWL-078, 090

*May be used as isolation valve only. Do not use as a pump-down solenoid. Refer to system wiring diagram.

STANDARD UNIT FEATURES

CABINET—Galvanized steel with powder coat paint finish. The powder coat paint finish is high gloss, durable and capable of withstanding a 1000-HR salt spray test per ASTM B117. The unit is of the frame and panel type of construction which allows all access panels to be opened or removed without affecting the structural strength of the unit. Fastening screws are also of the 1000-HR type. Stamped louver panels offer 100% protection for the condenser coil.

BASE PAN—Galvanized steel with powder coat paint finish.

SERVICE ACCESS—Control box with separation between line and control voltages, as well as compressor and other refrigerant controls are accessible through removable panel without affecting normal operation of unit.

FAN MOTOR—Condenser fan motor(s) are mounted on removable top panel(s) which bring the motor(s) out to you and expose entire condenser coil for cleaning.

COMPRESSOR—The Scroll Compressor is hermetically sealed with internal high temperature protection, and durable insulation on motor windings. The entire compressor is mounted on rubber grommets to reduce vibration and noise. Compressors have an internal pressure relief assembly to protect against excessive pressure differential. There is a separate compressor compartment for easy service access.

COMPRESSOR CRANKCASE HEATER—External wrap-around heater helps prevent refrigerant migration to the compressor oil during long off periods.

CONDENSER COILS—Constructed with copper tubes and aluminum fins mechanically bonded to tubes for maximum heat transfer capabilities. All coil assemblies are leak tested up to 450 PSIG internal pressure.

REFRIGERANT CONNECTIONS—All field sweat joints are made external of the unit and are located close to the ground for a neat looking installation.

LOW AMBIENT CONTROL—A pressure sensitive fan cycling control allows operation of units down to 0°F [-18°C].

HIGH PRESSURE CONTROL—Manual reset control deactivates system if abnormally high pressure occurs.

LOW PRESSURE CONTROL—Automatic reset control deactivates system if abnormally low pressure or refrigerant loss occurs.

SERVICE VALVES—Standard on liquid and suction lines.

CONDENSER FAN MOTORS—Direct drive, single-phase permanently lubricated “PSC” motors with inherent overload protection.

TRANSFORMER—50VA step-down type, from Line to 24 volts.

CONTACTOR—The contactor is an electrical switch which operates the compressor and condenser fans. Its 24 volt coil is activated through the High Pressure Control and Low Pressure Control on a call for cooling.

EQUIPMENT GROUND—Lug for field connection of ground wire.

TESTING—All units are run tested at the factory prior to shipment. Units are shipped with a holding charge of nitrogen.

CONTROL BOX—The control box is located at the top of the cabinet providing for easy access through a service panel.

COMPRESSOR TIME DELAY CONTROL—Compressor will remain off for five minutes after power or thermostat interruption, allowing system pressures to equalize. (Model No. RXMD-B01)

FILTER/DRIER—A liquid line filter drier is shipped with each unit for field installation.

[] Designates Metric Conversions

SELECTION PROCEDURE— MATCHED SYSTEMS

Example 1: Determine the Net System Performance of Condensing Unit SAWL-090 with SHGL-090 at 2760 CFM [1303 L/s] @ .30" [.07 kPa] external static pressure, 80°F [27°C] DB/67°F [19°C] WB entering indoor air and 95°F [35°C] DB outdoor ambient.

From Performance Data—Condensing Unit SAWL-090 with Air Handler SHGL-090:

$$\begin{aligned}\text{Total Cap. (gross)} &= 83.6 \times 1000 = 83,600 \text{ BTUH [24.5 kW]} \\ \text{Sens. Cap. (gross)} &= 66.3 \times 1000 = 66,300 \text{ BTUH [19.4 kW]} \\ \text{Power (gross)} &= 6.7 \times 1000 = 6,700 \text{ WATTS}\end{aligned}$$

From Commercial Air Handler, Wet Coil Airflow Performance Data:

$$\begin{aligned}\text{Power} &= 845 \text{ WATTS} \\ &= 845 \times 3.412 = 2883 \text{ BTUH [.84 kW]}\end{aligned}$$

Therefore, the Net Performance is:

$$\begin{aligned}\text{Total Cap. (Net)} &= 83,600 - 2,883 = 80,717 \text{ BTUH [23.66 kW]} \\ \text{Sens. Cap (Net)} &= 66,300 - 2,883 = 63,417 \text{ BTUH [18.59 kW]} \\ \text{Power (Net)} &= 6,700 + 845 = 7,545 \text{ WATTS} \\ \text{EER} &= 80,717 \div 7,545 = 10.69 \text{ BTUH [3.13 w/w] WATT}\end{aligned}$$

Example 2: Determine the Sensible Net Capacity at 75°F [27°C] DB entering indoor air with the other conditions from Example 1 being the same.

From Performance Data—Condensing Unit SAWL-090 with Air Handler SHGL-090

$$\begin{aligned}\text{Sens. Cap (Net)} &= 66,300 \text{ BTUH [19.43 kW]} \\ &\text{(from Example 1)}\end{aligned}$$

Adjust Capacity for temperature other than 80°F [27°C] entering air:

$$\text{Adjustment: } [1.10 \times 2760 \times (1-.04) \times (75-80)] = -13,248 \text{ BTUH [3.87 kW]}$$

Therefore, Sensible Capacity (Net) at 75°F [24°C] entering air is:

$$66,300 - 13,248 = 53,052 \text{ BTUH [15.55 kW] (Sens.)}$$

Example 3: Determine Net System Capacity Performance with 150 feet [45.7 m] equivalent length of 1³/₈" [34.9 mm] O.D. vapor line, with other conditions in example 1 being the same.

From piping chart, Vapor Line System Capacity Loss, in this booklet:

$$\text{Capacity Loss} = 1.3\% \text{ per } 100 [30.5\text{m}] \text{ feet of line}$$

The condensing unit Performance Data includes 25 feet [7.6 m] of recommended vapor line; therefore, calculate the System performance with 125 feet [38.1 m] of additional line:

$$\begin{aligned}\text{Total Cap. (gross)} &= 83,600 - [(.013 \times 125 \div 100) \times 83,600] = 82,242 \text{ BTUH [24.10 kW]} \\ \text{Sens. Cap (gross)} &= 66,300 - [(.013 \times 125 \div 100) \times 66,300] = 65,223 \text{ BTUH [19.11 kW]}\end{aligned}$$

Thus, the Net Performance is:

$$\begin{aligned}\text{Total Cap. (Net)} &= 82,242 - 2,883 = 79,354 \text{ BTUH [23.26 kW]} \\ \text{Sens. Cap. (Net)} &= 65,223 - 2,883 = 62,340 \text{ BTUH [18.27 kW]}\end{aligned}$$

[] Designates Metric Conversions

CONDENSING UNIT—GROSS CAPACITY AND POWER

SAWL-078						
°F [°C] OUTDOOR AMBIENT TEMPERATURE	SATURATED EVAPORATOR TEMPERATURE					
	40 [4]		45 [7]		50 [10]	
	MBH [kW]	KW	MBH [kW]	KW	MBH [kW]	KW
75 [24]	58.3 [17.07]	4.0	63.2 [18.51]	4.1	68.5 [20.07]	4.1
80 [27]	56.4 [16.53]	4.3	61.5 [18.02]	4.3	66.7 [19.55]	4.4
85 [29]	54.7 [16.01]	4.5	59.6 [17.46]	4.5	65.0 [19.03]	4.5
90 [32]	52.9 [15.50]	4.7	57.8 [16.94]	4.8	63.0 [18.47]	4.8
95 [35]	51.0 [14.93]	4.9	56.0 [16.42]	5.0	61.3 [17.95]	5.0
100 [38]	49.2 [14.41]	5.2	54.2 [15.88]	5.3	59.4 [17.41]	5.3
105 [41]	47.4 [13.87]	5.4	52.3 [15.34]	5.5	57.7 [16.89]	5.5
110 [43]	45.6 [13.36]	5.8	50.5 [14.80]	5.8	55.8 [16.35]	5.9
115 [46]	43.7 [12.82]	6.0	48.7 [14.28]	6.1	54.0 [15.81]	6.2

SAWL-090						
°F [°C] OUTDOOR AMBIENT TEMPERATURE	SATURATED EVAPORATOR TEMPERATURE					
	40 [4]		45 [7]		50 [10]	
	MBH [kW]	KW	MBH [kW]	KW	MBH [kW]	KW
75 [24]	80.4 [23.56]	5.0	87.1 [25.51]	5.2	93.9 [27.51]	5.3
80 [27]	78.1 [22.87]	5.3	84.7 [24.80]	5.4	91.6 [26.83]	5.5
85 [29]	75.7 [22.17]	5.5	82.2 [24.10]	5.7	89.2 [26.15]	5.8
90 [32]	73.3 [21.48]	5.9	79.8 [23.39]	5.9	86.8 [25.44]	6.0
95 [35]	70.9 [20.78]	6.1	77.4 [22.68]	6.2	84.4 [24.73]	6.4
100 [38]	68.5 [20.07]	6.4	75.2 [22.02]	6.5	82.1 [24.05]	6.7
105 [41]	66.1 [19.36]	6.8	81.1 [23.75]	6.9	79.7 [23.34]	7.0
110 [43]	63.7 [18.68]	7.2	70.3 [20.60]	7.3	77.2 [22.63]	7.4
115 [46]	61.4 [17.99]	7.6	67.9 [19.90]	7.8	74.8 [21.92]	7.9

KW —Condensing Unit Power (Compressor + Fan)


MBH—Gross Capacity X 1000 BTUH

NOTES: 1. All values at approximately 20°F [11.1°C] subcooling

2. Data includes 25 feet [7.62 m] of recommended vapor and liquid lines

[] Designates Metric Conversions

UNIT DIMENSIONS & WEIGHTS

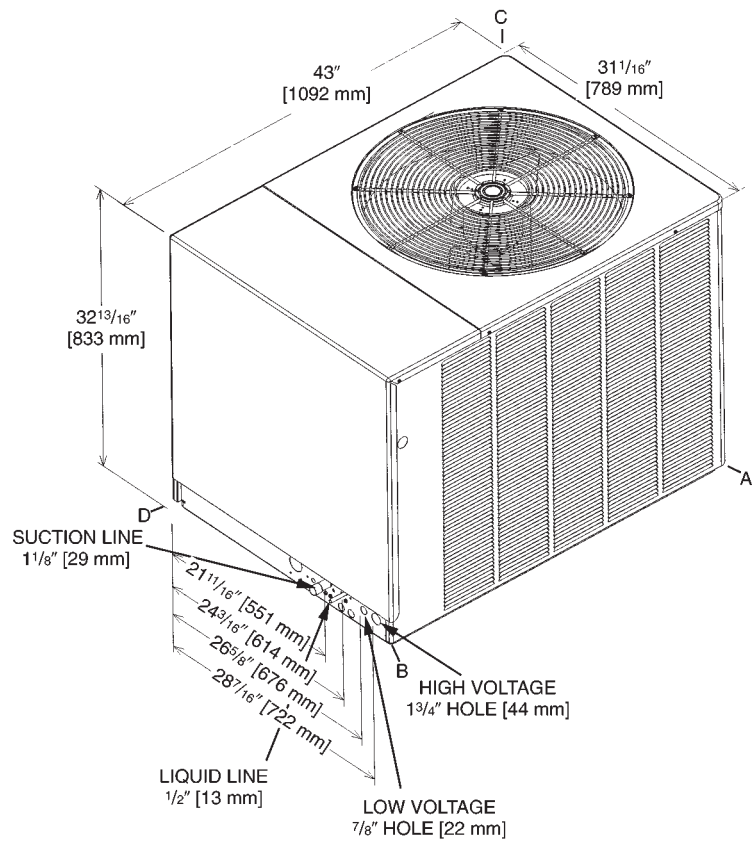

6.5 TON [22.86 kW] 7.5 TON [26.38 kW]
CORNER WEIGHTS (LBS.) [kg]

MODEL	TOTAL WEIGHT LBS. [kg]	Corner Weights, Lbs. [kg]			
		A	B	C	D
SAWL-078	291 [132.0]	50 [22.7]	73 [33.1]	69 [31.3]	99 [45.0]
SAWL-090	318 [144.2]	53 [24.0]	84 [38.1]	71 [32.2]	110 [50.0]

[] Designates Metric Conversions

PERFORMANCE DATA @ ARI STANDARD CONDITIONS—COOLING: SAWL-

MODEL NUMBERS		80°F [26.5°C] DB/67°F [19.5°C] WB INDOOR AIR 95°F [35°C] DB OUTDOOR AIR				SOUND RATING dB	INDOOR CFM [L/s]
OUTDOOR UNIT SAWL-	INDOOR COIL AND/OR AIR HANDLER	GROSS CAPACITY BTU/H [kW]	GROSS SENSIBLE BTU/H [kW]	LATENT BTU/H [kW]	EER		
Rev. 2/20/2009							
078NAZ	SHGL-090N	67,539 [19.8]	51,539 [15.1]	16,000 [4.7]	11.2	86	2,200 [1038]
078PAZ	SHGL-090P	67,539 [19.8]	51,539 [15.1]	16,000 [4.7]	11.2	86	2,200 [1038]
090NAZ	SHGL-090N	80,696 [23.6]	57,696 [16.9]	23,000 [6.7]	11.2	86	2,300 [1085]
	SHGL-120N	82,696 [24.2]	59,696 [17.5]	23,000 [6.7]	11.2	86	2,600 [1227]
090PAZ	SHGL-090P	80,696 [23.6]	57,696 [16.9]	23,000 [6.7]	11.2	86	2,300 [1085]
	SHGL-120P	82,696 [24.2]	59,696 [17.5]	23,000 [6.7]	11.2	86	2,600 [1227]

[] Designates Metric Conversions

ELECTRICAL & PHYSICAL DATA: SAWL-

Model No. SAWL-	ELECTRICAL					PHYSICAL								
	Phase Frequency (Hz) Voltage (Volts)	Compressor		Fan Motor Full Load Amperes (FLA)	Minimum Circuit Ampacity Amperes	Fuse or HACR Circuit Breaker		Outdoor Coil			Refrig. Per Circuit Oz. [g]	Weight		
		Rated Load Amperes (RLA)	Locked Rotor Amperes (LRA)			Minimum Amperes	Maximum Amperes	Face Area Sq. Ft. [Sq. m]	No. Rows	CFM [L/s]		Net Lbs. [kg]	Ship Lbs. [kg]	
Rev. 2/20/2009														
078NAZ	3-50-380/415	10.6/10.6	75	1.3	15/15	20/20	25/25	23 [2.14]	1.5	3900 [1840]	178 [5046]	291 [132]	314 [142.4]	
078PAZ	3-50-200/220	22.4/22.4	149	2.2	31/31	40/40	50/50	23 [2.14]	1.5	3900 [1840]	178 [5046]	291 [132]	314 [142.4]	
078VAZ	3-60-380	12.2	88	1.3	17	20	25	23 [2.14]	1.5	4700 [2218]	178 [5046]	291 [132]	314 [142.4]	
090NAZ	3-50-380/415	12.2/12.2	100	1.3	17/17	20/20	25/25	23 [2.14]	2.0	3900 [1840]	242 [6861]	318 [144.2]	341 [154.7]	
090PAZ	3-50-200/220	25/25	164	2.2	34/34	40/40	50/50	23 [2.14]	2.0	3900 [1840]	242 [6861]	318 [144.2]	341 [154.7]	
090VAZ	3-60-380	12.2	100	1.3	17	20	25	23 [2.14]	2.0	4700 [2218]	242 [6861]	318 [144.2]	341 [154.7]	

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-078NAZ

WITH
COOLING
COIL

SHGL-090N

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			2640 [1246]	2200 [1038]	1760 [831]	2640 [1246]	2200 [1038]	1760 [831]	2640 [1246]	2200 [1038]	1760 [831]
DR ①			.08	.09	.13	.08	.09	.13	.08	.09	.13
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	80.5 [23.6]	77.7 [22.8]	74.9 [21.9]	77.8 [22.8]	75.1 [22.0]	72.3 [21.2]	74.5 [21.8]	71.9 [21.1]	69.3 [20.3]
		Sens BTUH [kW]	51.9 [15.2]	44.7 [13.1]	38.0 [13.1]	62.0 [18.2]	54.0 [15.8]	46.4 [15.8]	68.3 [20.0]	59.9 [17.6]	52.0 [17.6]
		Power	4.7	4.6	4.5	4.6	4.5	4.5	4.6	4.5	4.4
	80 [26.7]	Total BTUH [kW]	78.8 [23.1]	76.0 [22.3]	73.3 [21.5]	76.1 [22.3]	73.4 [21.5]	70.7 [20.7]	72.8 [21.3]	70.2 [20.6]	67.7 [19.8]
		Sens BTUH [kW]	51.6 [15.1]	44.4 [13.0]	37.8 [13.0]	61.6 [18.0]	53.6 [15.7]	46.1 [15.7]	68.0 [19.9]	59.6 [17.5]	51.8 [17.5]
		Power	4.9	4.8	4.7	4.8	4.7	4.7	4.8	4.7	4.6
	85 [29.4]	Total BTUH [kW]	76.9 [22.5]	74.2 [21.7]	71.5 [20.9]	74.2 [21.7]	71.6 [21.0]	69.0 [20.2]	70.9 [20.8]	68.4 [20.0]	65.9 [19.3]
		Sens BTUH [kW]	50.9 [14.9]	43.9 [12.9]	37.4 [12.9]	60.9 [17.8]	53.1 [15.6]	45.8 [15.6]	67.3 [19.7]	59.1 [17.3]	51.3 [17.3]
		Power	5.1	5.0	4.9	5.1	5.0	4.9	5.0	4.9	4.8
	90 [32.2]	Total BTUH [kW]	74.9 [21.9]	72.3 [21.2]	69.6 [20.4]	72.2 [21.2]	69.6 [20.4]	67.1 [19.7]	68.9 [20.2]	66.5 [19.5]	64.1 [18.8]
		Sens BTUH [kW]	50.1 [14.7]	43.2 [12.7]	36.7 [12.7]	60.1 [17.6]	52.4 [15.4]	45.2 [15.4]	66.5 [19.5]	58.4 [17.1]	50.8 [17.1]
		Power	5.3	5.3	5.2	5.3	5.2	5.1	5.2	5.1	5.1
95 [35]	Total BTUH [kW]	72.7 [21.3]	70.2 [20.6]	67.6 [19.8]	70.0 [20.5]	67.5 [19.8]	65.1 [19.1]	66.7 [19.5]	64.4 [18.9]	62.0 [18.2]	
	Sens BTUH [kW]	49.0 [14.4]	42.3 [12.4]	36.0 [12.4]	59.0 [17.3]	51.5 [15.1]	44.5 [15.1]	65.4 [19.2]	57.5 [16.8]	50.0 [16.8]	
	Power	5.6	5.5	5.4	5.5	5.4	5.3	5.5	5.4	5.3	
100 [37.8]	Total BTUH [kW]	70.4 [20.6]	68.0 [19.9]	65.5 [19.2]	67.7 [19.8]	65.3 [19.1]	62.9 [18.4]	64.4 [18.9]	62.2 [18.2]	59.9 [17.6]	
	Sens BTUH [kW]	47.8 [14.0]	41.3 [12.1]	35.2 [12.1]	57.7 [16.9]	50.4 [14.8]	43.5 [14.8]	64.2 [18.8]	56.5 [16.6]	49.1 [16.6]	
	Power	5.9	5.8	5.7	5.8	5.7	5.6	5.7	5.6	5.5	
105 [40.6]	Total BTUH [kW]	68.0 [19.9]	65.6 [19.2]	63.2 [18.5]	65.3 [19.1]	63.0 [18.5]	60.7 [17.8]	62.0 [18.2]	59.8 [17.5]	57.6 [16.9]	
	Sens BTUH [kW]	46.4 [13.6]	40.0 [11.7]	34.1 [11.7]	56.3 [16.5]	49.2 [14.4]	42.5 [14.4]	62.0 [18.2]	55.2 [16.2]	48.1 [16.2]	
	Power	6.1	6.0	5.9	6.1	6.0	5.9	6.0	5.9	5.8	
110 [43.3]	Total BTUH [kW]	65.4 [19.2]	63.1 [18.5]	60.8 [17.8]	62.7 [18.4]	60.5 [17.7]	58.3 [17.1]	59.4 [17.4]	57.3 [16.8]	55.2 [16.2]	
	Sens BTUH [kW]	44.6 [13.1]	38.5 [11.3]	32.8 [11.3]	54.7 [16.0]	47.8 [14.0]	41.3 [14.0]	59.4 [17.4]	53.7 [15.7]	46.8 [15.7]	
	Power	6.4	6.3	6.2	6.4	6.3	6.1	6.3	6.2	6.1	
115 [46.1]	Total BTUH [kW]	62.7 [18.4]	60.5 [17.7]	58.3 [17.1]	60.0 [17.6]	57.8 [16.9]	55.7 [16.3]	56.7 [16.6]	54.7 [16.0]	52.7 [15.4]	
	Sens BTUH [kW]	42.7 [12.5]	36.9 [10.8]	31.5 [10.8]	52.7 [15.4]	46.0 [13.5]	39.8 [13.5]	56.7 [16.6]	52.1 [15.3]	45.4 [15.3]	
	Power	6.7	6.6	6.5	6.7	6.6	6.4	6.6	6.5	6.4	
120 [48.9]	Total BTUH [kW]	59.8 [17.5]	57.7 [16.9]	55.6 [16.3]	57.1 [16.7]	55.1 [16.1]	53.1 [15.6]	53.8 [15.8]	51.9 [15.2]	50.0 [14.6]	
	Sens BTUH [kW]	40.6 [11.9]	35.0 [10.3]	29.8 [10.3]	50.5 [14.8]	44.2 [13.0]	38.3 [13.0]	53.8 [15.8]	50.2 [14.7]	43.8 [14.6]	
	Power	7.0	6.9	6.8	7.0	6.9	6.7	6.9	6.8	6.7	

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—KW input

NOTES:

① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.

③ Power input is gross, which does not include indoor blower motor.

④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-078PAZ

WITH
COOLING
COIL

SHGL-090P

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			2640 [1246]	2200 [1038]	1760 [831]	2640 [1246]	2200 [1038]	1760 [831]	2640 [1246]	2200 [1038]	1760 [831]
DR ①			.06	.09	.13	.06	.09	.13	.06	.09	.13
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	80.5 [23.6] 51.9 [15.2] 4.7	77.7 [22.8] 44.7 [13.1] 4.6	74.9 [21.9] 38.0 [13.1] 4.5	77.8 [22.8] 62.0 [18.2] 4.6	75.1 [22.0] 54.0 [15.8] 4.5	72.3 [21.2] 46.4 [15.8] 4.5	74.5 [21.8] 68.3 [20.0] 4.6	71.9 [21.1] 59.9 [17.6] 4.5	69.3 [20.3] 52.0 [17.6] 4.4
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	78.8 [23.1] 51.6 [15.1] 4.9	76.0 [22.3] 44.4 [13.0] 4.8	73.3 [21.5] 37.8 [13.0] 4.7	76.1 [22.3] 61.6 [18.0] 4.8	73.4 [21.5] 53.6 [15.7] 4.7	70.7 [20.7] 46.1 [15.7] 4.7	72.8 [21.3] 68.0 [19.9] 4.8	70.2 [20.6] 59.6 [17.5] 4.7	67.7 [19.8] 51.8 [17.5] 4.6
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	76.9 [22.5] 50.9 [14.9] 5.1	74.2 [21.7] 43.9 [12.9] 5.0	71.5 [20.9] 37.4 [12.9] 4.9	74.2 [21.7] 60.9 [17.8] 5.1	71.6 [21.0] 53.1 [15.6] 5.0	69.0 [20.2] 45.8 [15.6] 4.9	70.9 [20.8] 67.3 [19.7] 5.0	68.4 [20.0] 59.1 [17.3] 4.9	65.9 [19.3] 51.3 [17.3] 4.8
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	74.9 [21.9] 50.1 [14.7] 5.3	72.3 [21.2] 43.2 [12.7] 5.3	69.6 [20.4] 36.7 [12.7] 5.2	72.2 [21.2] 60.1 [17.6] 5.3	69.6 [20.4] 52.4 [15.4] 5.2	67.1 [19.7] 45.2 [15.4] 5.1	68.9 [20.2] 66.5 [19.5] 5.2	66.5 [19.5] 58.4 [17.1] 5.1	64.1 [18.8] 50.8 [17.1] 5.1
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	72.7 [21.3] 49.0 [14.4] 5.6	70.2 [20.6] 42.3 [12.4] 5.5	67.6 [19.8] 36.0 [12.4] 5.4	70.0 [20.5] 59.0 [17.3] 5.5	67.5 [19.8] 51.5 [15.1] 5.4	65.1 [19.1] 44.5 [15.1] 5.3	66.7 [19.5] 65.4 [19.2] 5.5	64.4 [18.9] 57.5 [16.8] 5.4	62.0 [18.2] 50.0 [16.8] 5.3
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	70.4 [20.6] 47.8 [14.0] 5.9	68.0 [19.9] 41.3 [12.1] 5.8	65.5 [19.2] 35.2 [12.1] 5.7	67.7 [19.8] 57.7 [16.9] 5.8	65.3 [19.1] 50.4 [14.8] 5.7	62.9 [18.4] 43.5 [14.8] 5.6	64.4 [18.9] 64.2 [18.8] 5.7	62.2 [18.2] 56.5 [16.6] 5.6	59.9 [17.6] 49.1 [16.6] 5.5
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	68.0 [19.9] 46.4 [13.6] 6.1	65.6 [19.2] 40.0 [11.7] 6.0	63.2 [18.5] 34.1 [11.7] 5.9	65.3 [19.1] 56.3 [16.5] 6.1	63.0 [18.5] 49.2 [14.4] 6.0	60.7 [17.8] 42.5 [14.4] 5.9	62.0 [18.2] 62.0 [18.2] 6.0	59.8 [17.5] 55.2 [16.2] 5.9	57.6 [16.9] 48.1 [16.2] 5.8
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	65.4 [19.2] 44.6 [13.1] 6.4	63.1 [18.5] 38.5 [11.3] 6.3	60.8 [17.8] 32.8 [11.3] 6.2	62.7 [18.4] 54.7 [16.0] 6.4	60.5 [17.7] 47.8 [14.0] 6.3	58.3 [17.1] 41.3 [14.0] 6.1	59.4 [17.4] 59.4 [17.4] 6.3	57.3 [16.8] 53.7 [15.7] 6.2	55.2 [16.2] 46.8 [15.7] 6.1
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	62.7 [18.4] 42.7 [12.5] 6.7	60.5 [17.7] 36.9 [10.8] 6.6	58.3 [17.1] 31.5 [10.8] 6.5	60.0 [17.6] 52.7 [15.4] 6.7	57.8 [16.9] 46.0 [13.5] 6.6	55.7 [16.3] 39.8 [13.5] 6.4	56.7 [16.6] 56.7 [16.6] 6.6	54.7 [16.0] 52.1 [15.3] 6.5	52.7 [15.4] 45.4 [15.3] 6.4
	120 [48.9]	Total BTUH [kW] Sens BTUH [kW] Power	59.8 [17.5] 40.6 [11.9] 7.0	57.7 [16.9] 35.0 [10.3] 6.9	55.6 [16.3] 29.8 [10.3] 6.8	57.1 [16.7] 50.5 [14.8] 7.0	55.1 [16.1] 44.2 [13.0] 6.9	53.1 [15.6] 38.3 [13.0] 6.7	53.8 [15.8] 53.8 [15.8] 6.9	51.9 [15.2] 50.2 [14.7] 6.8	50.0 [14.6] 43.8 [14.6] 6.7

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—kW input

NOTES:

① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.

③ Power input is gross, which does not include indoor blower motor.

④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-078VAZ

WITH
COOLING
COIL

SHGL-090N

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]
DR ①			.05	.08	.11	.05	.08	.11	.05	.08	.11
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	95.0 [27.8]	91.7 [26.9]	88.3 [25.9]	91.1 [26.7]	87.9 [25.8]	84.7 [24.8]	85.8 [25.1]	82.8 [24.3]	79.7 [23.4]
		Sens BTUH [kW]	63.6 [18.6]	54.9 [16.1]	46.7 [16.1]	74.6 [21.9]	65.0 [19.0]	56.0 [19.0]	80.6 [23.6]	70.7 [20.7]	61.3 [20.7]
		Power	5.4	5.3	5.2	5.3	5.2	5.1	5.2	5.1	5.0
	80 [26.7]	Total BTUH [kW]	92.9 [27.2]	89.6 [26.3]	86.3 [25.3]	89.0 [26.1]	85.8 [25.1]	82.7 [24.2]	83.6 [24.5]	80.7 [23.6]	77.8 [22.8]
		Sens BTUH [kW]	62.8 [18.4]	54.1 [15.9]	46.1 [15.9]	73.7 [21.6]	64.2 [18.8]	55.4 [18.8]	79.6 [23.3]	69.9 [20.5]	60.7 [20.5]
		Power	5.6	5.5	5.4	5.5	5.4	5.4	5.5	5.4	5.3
	85 [29.4]	Total BTUH [kW]	90.6 [26.5]	87.4 [25.6]	84.3 [24.7]	86.7 [25.4]	83.7 [24.5]	80.7 [23.6]	81.4 [23.8]	78.5 [23.0]	75.7 [22.2]
		Sens BTUH [kW]	61.6 [18.0]	53.1 [15.6]	45.3 [15.6]	72.5 [21.2]	63.3 [18.5]	54.7 [18.5]	78.6 [23.0]	69.0 [20.2]	60.0 [20.2]
		Power	5.9	5.8	5.7	5.8	5.7	5.6	5.7	5.6	5.5
	90 [32.2]	Total BTUH [kW]	88.3 [25.9]	85.2 [25.0]	82.1 [24.1]	84.4 [24.7]	81.4 [23.8]	78.5 [23.0]	79.1 [23.2]	76.3 [22.4]	73.5 [21.5]
		Sens BTUH [kW]	60.5 [17.7]	52.2 [15.3]	44.5 [15.3]	71.3 [20.9]	62.2 [18.2]	53.8 [18.2]	77.4 [22.7]	68.0 [19.9]	59.1 [19.9]
		Power	6.2	6.1	6.0	6.1	6.0	5.9	6.0	5.9	5.8
	95 [35]	Total BTUH [kW]	85.8 [25.1]	82.8 [24.3]	79.8 [23.4]	82.0 [24.0]	79.1 [23.2]	76.2 [22.3]	76.6 [22.4]	73.9 [21.7]	71.2 [20.9]
		Sens BTUH [kW]	58.9 [17.3]	50.9 [14.9]	43.4 [14.9]	70.0 [20.5]	61.1 [17.9]	52.8 [17.9]	75.9 [22.2]	66.7 [19.5]	58.0 [19.5]
		Power	6.5	6.4	6.2	6.4	6.3	6.2	6.3	6.2	6.1
	100 [37.8]	Total BTUH [kW]	83.3 [24.4]	80.4 [23.6]	77.5 [22.7]	79.4 [23.3]	76.6 [22.4]	73.8 [21.6]	74.1 [21.7]	71.5 [20.9]	68.9 [20.2]
		Sens BTUH [kW]	57.4 [16.8]	49.6 [14.5]	42.3 [14.5]	68.3 [20.0]	59.7 [17.5]	51.6 [17.5]	74.1 [21.7]	65.4 [19.2]	56.9 [19.2]
		Power	6.8	6.7	6.5	6.7	6.6	6.5	6.6	6.5	6.4
	105 [40.6]	Total BTUH [kW]	80.7 [23.6]	77.8 [22.8]	75.0 [22.0]	76.8 [22.5]	74.1 [21.7]	71.4 [20.9]	71.4 [20.9]	68.9 [20.2]	66.4 [19.5]
		Sens BTUH [kW]	55.8 [16.3]	48.1 [14.1]	41.1 [14.1]	66.7 [19.5]	58.3 [17.1]	50.4 [17.1]	71.4 [20.9]	63.9 [18.7]	55.7 [18.7]
		Power	7.1	7.0	6.9	7.0	6.9	6.8	6.9	6.8	6.7
	110 [43.3]	Total BTUH [kW]	77.9 [22.8]	75.2 [22.0]	72.4 [21.2]	74.0 [21.7]	71.4 [20.9]	68.8 [20.2]	68.7 [20.1]	66.3 [19.4]	63.9 [18.7]
		Sens BTUH [kW]	53.8 [15.8]	46.5 [13.6]	39.6 [13.6]	64.7 [19.0]	56.6 [16.6]	49.0 [16.6]	68.7 [20.1]	62.3 [18.3]	54.3 [18.3]
		Power	7.4	7.3	7.2	7.3	7.2	7.1	7.3	7.1	7.0
	115 [46.1]	Total BTUH [kW]	75.0 [22.0]	72.4 [21.2]	69.8 [20.5]	71.2 [20.9]	68.7 [20.1]	66.2 [19.4]	65.8 [19.3]	63.5 [18.6]	61.2 [17.9]
		Sens BTUH [kW]	51.7 [15.1]	44.7 [13.1]	38.2 [13.1]	62.8 [18.4]	54.9 [16.1]	47.5 [16.1]	65.8 [19.3]	60.5 [17.7]	52.8 [17.7]
		Power	7.8	7.7	7.5	7.7	7.6	7.4	7.6	7.5	7.4
	120 [48.9]	Total BTUH [kW]	72.1 [21.1]	69.6 [20.4]	67.0 [19.6]	68.2 [20.0]	65.8 [19.3]	63.4 [18.6]	62.9 [18.4]	60.7 [17.8]	58.4 [17.1]
		Sens BTUH [kW]	49.5 [14.5]	42.8 [12.5]	36.4 [12.5]	60.5 [17.7]	52.9 [15.5]	45.8 [15.5]	62.9 [18.4]	58.7 [17.2]	51.1 [17.1]
		Power	8.2	8.0	7.9	8.1	7.9	7.8	8.0	7.8	7.7

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—KW input

NOTES:

① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.

③ Power input is gross, which does not include indoor blower motor.

④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-090NAZ

WITH
COOLING
COIL

SHGL-090N

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			2760 [1303]	2300 [1086]	1840 [868]	2760 [1303]	2300 [1086]	1840 [868]	2760 [1303]	2300 [1086]	1840 [868]
DR ①			.04	.09	.16	.04	.09	.16	.04	.09	.16
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	94.2 [27.6]	90.9 [26.6]	87.6 [25.7]	91.4 [26.8]	88.2 [25.8]	85.0 [24.9]	88.2 [25.8]	85.1 [24.9]	82.0 [24.0]
		Sens BTUH [kW]	59.3 [17.4]	50.9 [14.9]	43.2 [14.9]	69.2 [20.3]	60.1 [17.6]	51.6 [17.6]	75.7 [22.2]	66.1 [19.4]	57.1 [19.4]
		Power	5.8	5.7	5.6	5.8	5.7	5.6	5.7	5.6	5.5
	80 [26.7]	Total BTUH [kW]	92.4 [27.1]	89.2 [26.1]	85.9 [25.2]	89.7 [26.3]	86.5 [25.3]	83.4 [24.4]	86.4 [25.3]	83.4 [24.4]	80.4 [23.6]
		Sens BTUH [kW]	58.8 [17.2]	50.6 [14.8]	42.9 [14.8]	68.8 [20.2]	59.7 [17.5]	51.3 [17.5]	75.2 [22.0]	65.8 [19.3]	56.9 [19.3]
		Power	6.0	5.9	5.8	6.0	5.9	5.8	5.9	5.8	5.7
	85 [29.4]	Total BTUH [kW]	90.6 [26.5]	87.4 [25.6]	84.2 [24.7]	87.8 [25.7]	84.7 [24.8]	81.7 [23.9]	84.5 [24.8]	81.6 [23.9]	78.6 [23.0]
		Sens BTUH [kW]	58.3 [17.1]	50.1 [14.7]	42.5 [14.7]	68.1 [20.0]	59.2 [17.3]	51.0 [17.3]	74.6 [21.9]	65.3 [19.1]	56.5 [19.1]
		Power	6.2	6.1	6.0	6.2	6.1	6.0	6.1	6.0	5.9
	90 [32.2]	Total BTUH [kW]	88.5 [25.9]	85.4 [25.0]	82.3 [24.1]	85.8 [25.1]	82.8 [24.3]	79.8 [23.4]	82.5 [24.2]	79.6 [23.3]	76.7 [22.5]
Sens BTUH [kW]		57.3 [16.8]	49.3 [14.4]	41.9 [14.4]	67.3 [19.7]	58.6 [17.2]	50.4 [17.2]	73.7 [21.6]	64.5 [18.9]	55.9 [18.9]	
Power		6.5	6.4	6.3	6.4	6.3	6.2	6.4	6.3	6.1	
95 [35]	Total BTUH [kW]	86.4 [25.3]	83.3 [24.4]	80.3 [23.5]	83.6 [24.5]	80.7 [23.6]	77.8 [22.8]	80.4 [23.6]	77.5 [22.7]	74.7 [21.9]	
	Sens BTUH [kW]	56.3 [16.5]	48.4 [14.2]	41.2 [14.2]	66.3 [19.4]	57.7 [16.9]	49.7 [16.9]	72.7 [21.3]	63.6 [18.6]	55.1 [18.6]	
	Power	6.7	6.6	6.5	6.7	6.6	6.4	6.6	6.5	6.4	
100 [37.8]	Total BTUH [kW]	84.1 [24.6]	81.1 [23.8]	78.2 [22.9]	81.3 [23.8]	78.5 [23.0]	75.6 [22.2]	78.1 [22.9]	75.3 [22.1]	72.6 [21.3]	
	Sens BTUH [kW]	55.1 [16.1]	47.4 [13.9]	40.3 [13.9]	64.9 [19.0]	56.6 [16.6]	48.7 [16.6]	71.5 [20.9]	62.6 [18.3]	54.3 [18.3]	
	Power	7.0	6.9	6.7	6.9	6.8	6.7	6.9	6.8	6.6	
105 [40.6]	Total BTUH [kW]	81.6 [23.9]	78.8 [23.1]	75.9 [22.2]	78.9 [23.1]	76.1 [22.3]	73.4 [21.5]	75.6 [22.2]	73.0 [21.4]	70.3 [20.6]	
	Sens BTUH [kW]	53.6 [15.7]	46.2 [13.5]	39.3 [13.5]	63.5 [18.6]	55.3 [16.2]	47.7 [16.2]	70.0 [20.5]	61.4 [18.0]	53.2 [18.0]	
	Power	7.3	7.1	7.0	7.2	7.1	7.0	7.2	7.0	6.9	
110 [43.3]	Total BTUH [kW]	79.0 [23.1]	76.3 [22.4]	73.5 [21.5]	76.3 [22.4]	73.6 [21.6]	71.0 [20.8]	73.0 [21.4]	70.5 [20.7]	67.9 [19.9]	
	Sens BTUH [kW]	51.8 [15.2]	44.7 [13.1]	38.0 [13.1]	61.9 [18.1]	53.9 [15.8]	46.5 [15.8]	68.2 [20.0]	59.9 [17.6]	52.0 [17.6]	
	Power	7.6	7.4	7.3	7.5	7.4	7.2	7.4	7.3	7.2	
115 [46.1]	Total BTUH [kW]	76.3 [22.4]	73.6 [21.6]	71.0 [20.8]	73.6 [21.6]	71.0 [20.8]	68.4 [20.0]	70.3 [20.6]	67.9 [19.9]	65.4 [19.2]	
	Sens BTUH [kW]	50.0 [14.6]	43.0 [12.6]	36.6 [12.6]	59.9 [17.6]	52.2 [15.3]	45.0 [15.3]	66.4 [19.5]	58.3 [17.1]	50.6 [17.1]	
	Power	7.9	7.7	7.6	7.8	7.7	7.5	7.7	7.6	7.5	
120 [48.9]	Total BTUH [kW]	73.5 [21.5]	70.9 [20.8]	68.3 [20.0]	70.7 [20.7]	68.2 [20.0]	65.8 [19.3]	67.5 [19.8]	65.1 [19.1]	62.7 [18.4]	
	Sens BTUH [kW]	47.9 [14.0]	41.2 [12.1]	35.0 [12.1]	57.7 [16.9]	50.3 [14.7]	43.4 [14.7]	64.3 [18.8]	56.4 [16.5]	49.0 [16.5]	
	Power	8.2	8.0	7.9	8.1	8.0	7.8	8.1	7.9	7.8	

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—kW input

NOTES:

① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.

③ Power input is gross, which does not include indoor blower motor.

④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING UNIT **SAWL-090NAZ** WITH COOLING COIL **SHGL-120N**

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]
DR ①			.11	.15	.21	.11	.15	.21	.11	.15	.21
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	96.2 [28.2]	92.9 [27.2]	89.5 [26.2]	93.5 [27.4]	90.2 [26.4]	86.9 [25.5]	90.2 [26.4]	87.1 [25.5]	83.9 [24.6]
		Sens BTUH [kW]	61.4 [18.0]	52.9 [15.5]	44.9 [15.5]	71.5 [20.9]	62.1 [18.2]	53.3 [18.2]	77.8 [22.8]	68.1 [20.0]	58.8 [20.0]
		Power	6.0	5.9	5.8	5.9	5.8	5.7	5.9	5.8	5.7
	80 [26.7]	Total BTUH [kW]	94.5 [27.7]	91.2 [26.7]	87.9 [25.8]	91.8 [26.9]	88.5 [25.9]	85.3 [25.0]	88.5 [25.9]	85.4 [25.0]	82.3 [24.1]
		Sens BTUH [kW]	61.1 [17.9]	52.6 [15.4]	44.7 [15.4]	71.1 [20.8]	61.7 [18.1]	53.0 [18.1]	77.5 [22.7]	67.8 [19.9]	58.7 [19.9]
		Power	6.2	6.1	6.0	6.1	6.0	5.9	6.1	6.0	5.9
	85 [29.4]	Total BTUH [kW]	92.6 [27.1]	89.4 [26.2]	86.1 [25.2]	89.9 [26.3]	86.7 [25.4]	83.6 [24.5]	86.6 [25.4]	83.6 [24.5]	80.5 [23.6]
		Sens BTUH [kW]	60.5 [17.7]	52.1 [15.3]	44.2 [15.3]	70.4 [20.6]	61.2 [17.9]	52.7 [17.9]	76.9 [22.5]	67.3 [19.7]	58.2 [19.7]
		Power	6.4	6.3	6.2	6.4	6.3	6.1	6.3	6.2	6.1
	90 [32.2]	Total BTUH [kW]	90.6 [26.5]	87.4 [25.6]	84.2 [24.7]	87.9 [25.8]	84.8 [24.8]	81.7 [23.9]	84.6 [24.8]	81.6 [23.9]	78.7 [23.1]
		Sens BTUH [kW]	59.6 [17.5]	51.3 [15.0]	43.6 [15.0]	69.6 [20.4]	60.6 [17.8]	52.1 [17.8]	76.0 [22.3]	66.5 [19.5]	57.7 [19.5]
		Power	6.7	6.5	6.4	6.6	6.5	6.4	6.5	6.4	6.3
95 [35]	Total BTUH [kW]	88.4 [25.9]	85.3 [25.0]	82.2 [24.1]	85.7 [25.1]	82.7 [24.2]	79.7 [23.4]	82.4 [24.1]	79.5 [23.3]	76.7 [22.5]	
	Sens BTUH [kW]	58.5 [17.1]	50.4 [14.8]	42.9 [14.8]	68.6 [20.1]	59.7 [17.5]	51.4 [17.5]	74.9 [21.9]	65.6 [19.2]	56.9 [19.2]	
	Power	6.9	6.8	6.7	6.9	6.7	6.6	6.8	6.7	6.6	
100 [37.8]	Total BTUH [kW]	86.1 [25.2]	83.1 [24.3]	80.1 [23.5]	83.4 [24.4]	80.5 [23.6]	77.5 [22.7]	80.1 [23.5]	77.3 [22.6]	74.5 [21.8]	
	Sens BTUH [kW]	57.3 [16.8]	49.4 [14.5]	42.1 [14.5]	67.2 [19.7]	58.6 [17.2]	50.4 [17.2]	73.7 [21.6]	64.6 [18.9]	56.0 [18.9]	
	Power	7.2	7.0	6.9	7.1	7.0	6.9	7.1	6.9	6.8	
105 [40.6]	Total BTUH [kW]	83.7 [24.5]	80.8 [23.7]	77.8 [22.8]	81.0 [23.7]	78.1 [22.9]	75.3 [22.1]	77.7 [22.8]	75.0 [22.0]	72.2 [21.2]	
	Sens BTUH [kW]	55.9 [16.4]	48.2 [14.1]	41.0 [14.1]	65.8 [19.3]	57.3 [16.8]	49.4 [16.8]	72.3 [21.2]	63.4 [18.6]	54.9 [18.6]	
	Power	7.4	7.3	7.2	7.4	7.3	7.1	7.3	7.2	7.1	
110 [43.3]	Total BTUH [kW]	81.1 [23.8]	78.3 [22.9]	75.4 [22.1]	78.4 [23.0]	75.6 [22.2]	72.9 [21.4]	75.1 [22.0]	72.5 [21.2]	69.8 [20.5]	
	Sens BTUH [kW]	54.1 [15.9]	46.7 [13.7]	39.7 [13.7]	64.2 [18.8]	55.9 [16.4]	48.2 [16.4]	70.5 [20.7]	61.9 [18.1]	53.7 [18.1]	
	Power	7.7	7.6	7.5	7.7	7.5	7.4	7.6	7.5	7.4	
115 [46.1]	Total BTUH [kW]	78.4 [23.0]	75.6 [22.2]	72.9 [21.4]	75.7 [22.2]	73.0 [21.4]	70.4 [20.6]	72.4 [21.2]	69.9 [20.5]	67.3 [19.7]	
	Sens BTUH [kW]	52.3 [15.3]	45.0 [13.2]	38.4 [13.2]	62.2 [18.2]	54.2 [15.9]	46.8 [15.9]	68.7 [20.1]	60.3 [17.7]	52.3 [17.7]	
	Power	8.0	7.9	7.8	8.0	7.8	7.7	7.9	7.8	7.7	
120 [48.9]	Total BTUH [kW]	75.5 [22.1]	72.9 [21.4]	70.2 [20.6]	72.8 [21.3]	70.2 [20.6]	67.7 [19.8]	69.5 [20.4]	67.1 [19.7]	64.7 [19.0]	
	Sens BTUH [kW]	50.1 [14.7]	43.2 [12.7]	36.7 [12.7]	60.0 [17.6]	52.3 [15.3]	45.2 [15.3]	66.5 [19.5]	58.4 [17.1]	50.8 [17.1]	
	Power	8.4	8.2	8.1	8.3	8.2	8.0	8.2	8.1	8.0	

DR —Depression ratio
dbE —Entering air dry bulb
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power—KW input

[] Designates Metric Conversions

NOTES:

- ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.
- ② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.
- ③ Power input is gross, which does not include indoor blower motor.
- ④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-090PAZ

WITH
COOLING
COIL

SHGL-090P

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①										
wbE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]		2760 [1303]	2300 [1086]	1840 [868]	2760 [1303]	2300 [1086]	1840 [868]	2760 [1303]	2300 [1086]	1840 [868]
DR ①		.04	.09	.16	.04	.09	.16	.04	.09	.16
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	94.9 [27.8] 58.1 [17.0] 5.6	91.6 [26.8] 49.8 [14.6] 5.5	88.3 [25.9] 42.2 [14.6] 5.4	91.2 [26.7] 69.0 [20.2] 5.5	88.0 [25.8] 59.9 [17.6] 5.4	84.8 [24.8] 51.4 [17.6] 5.3	87.2 [25.5] 77.1 [22.6] 5.4	84.1 [24.6] 67.4 [19.7] 5.3
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	93.3 [27.3] 57.8 [16.9] 5.9	90.0 [26.4] 49.6 [14.5] 5.8	86.7 [25.4] 42.0 [14.5] 5.7	89.5 [26.2] 68.7 [20.1] 5.8	86.4 [25.3] 59.7 [17.5] 5.7	83.3 [24.4] 51.3 [17.5] 5.6	85.5 [25.1] 76.8 [22.5] 5.7	82.5 [24.2] 67.2 [19.7] 5.6
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	91.4 [26.8] 57.2 [16.8] 6.2	88.2 [25.8] 49.1 [14.4] 6.1	85.0 [24.9] 41.6 [14.4] 6.0	87.7 [25.7] 68.1 [20.0] 6.1	84.6 [24.8] 59.2 [17.3] 6.0	81.6 [23.9] 51.0 [17.3] 5.8	83.7 [24.5] 76.2 [22.3] 5.9	80.7 [23.6] 66.7 [19.5] 5.8
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	89.5 [26.2] 56.4 [16.5] 6.5	86.3 [25.3] 48.4 [14.2] 6.4	83.2 [24.4] 41.1 [14.2] 6.3	85.7 [25.1] 67.2 [19.7] 6.4	82.7 [24.2] 58.5 [17.1] 6.2	79.7 [23.4] 50.3 [17.1] 6.1	81.7 [23.9] 75.3 [22.1] 6.2	78.8 [23.1] 66.0 [19.3] 6.1
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	87.3 [25.6] 55.3 [16.2] 6.8	84.3 [24.7] 47.6 [13.9] 6.7	81.2 [23.8] 40.3 [13.9] 6.6	83.6 [24.5] 66.3 [19.4] 6.7	80.7 [23.6] 57.7 [16.9] 6.6	77.8 [22.8] 49.7 [16.9] 6.4	79.6 [23.3] 74.3 [21.8] 6.6	76.8 [22.5] 65.2 [19.1] 6.4
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	85.1 [24.9] 54.1 [15.9] 7.1	82.1 [24.1] 46.5 [13.6] 7.0	79.1 [23.2] 39.4 [13.6] 6.9	81.4 [23.8] 65.1 [19.1] 7.0	78.5 [23.0] 56.6 [16.6] 6.9	75.7 [22.2] 48.8 [16.6] 6.8	77.3 [22.6] 73.0 [21.4] 6.9	74.6 [21.9] 64.1 [18.8] 6.8
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	82.7 [24.2] 52.7 [15.4] 7.5	79.8 [23.4] 45.3 [13.3] 7.4	76.9 [22.5] 38.4 [13.3] 7.2	79.0 [23.1] 63.6 [18.6] 7.4	76.2 [22.3] 55.4 [16.2] 7.2	73.5 [21.5] 47.8 [16.2] 7.1	75.0 [22.0] 71.6 [21.0] 7.2	72.3 [21.2] 62.8 [18.4] 7.1
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	80.2 [23.5] 50.9 [14.9] 7.9	77.4 [22.7] 43.8 [12.8] 7.7	74.6 [21.9] 37.2 [12.8] 7.6	76.5 [22.4] 61.9 [18.1] 7.7	73.8 [21.6] 53.9 [15.8] 7.6	71.1 [20.8] 46.4 [15.8] 7.5	72.4 [21.2] 69.9 [20.5] 7.6	69.9 [20.5] 61.4 [18.0] 7.5
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	77.5 [22.7] 49.0 [14.4] 8.2	74.8 [21.9] 42.1 [12.3] 8.1	72.1 [21.1] 35.7 [12.3] 8.0	73.8 [21.6] 59.9 [17.6] 8.1	71.2 [20.9] 52.2 [15.3] 8.0	68.6 [20.1] 45.0 [15.3] 7.8	69.8 [20.5] 68.0 [19.9] 8.0	67.3 [19.7] 59.7 [17.5] 7.9
	120 [48.9]	Total BTUH [kW] Sens BTUH [kW] Power	74.7 [21.9] 46.9 [13.7] 8.6	72.1 [21.1] 40.3 [11.8] 8.5	69.5 [20.4] 34.2 [11.8] 8.3	71.0 [20.8] 57.8 [16.9] 8.5	68.5 [20.1] 50.4 [14.8] 8.4	66.0 [19.3] 43.4 [14.8] 8.2	67.0 [19.6] 65.9 [19.3] 8.4	64.6 [18.9] 57.9 [17.0] 8.2

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—kW input

NOTES:

- ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.
- ② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.
- ③ Power input is gross, which does not include indoor blower motor.
- ④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-090PAZ

WITH
COOLING
COIL

SHGL-120P

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]	3120 [1473]	2600 [1227]	2080 [982]
DR ①			.11	.15	.21	.11	.15	.21	.11	.15	.21
OUT DOOR D R Y B U L B T E M P E R A T U R E °F [°C]	75 [23.9]	Total BTUH [kW]	97.0 [28.4]	93.6 [27.4]	90.2 [26.4]	93.3 [27.3]	90.0 [26.4]	86.7 [25.4]	89.2 [26.1]	86.1 [25.2]	83.0 [24.3]
		Sens BTUH [kW]	60.4 [17.7]	51.8 [15.2]	43.9 [15.2]	71.3 [20.9]	61.9 [18.1]	53.1 [18.1]	79.3 [23.2]	69.4 [20.3]	60.1 [20.3]
		Power	5.8	5.7	5.6	5.7	5.6	5.5	5.6	5.5	5.4
	80 [26.7]	Total BTUH [kW]	95.3 [27.9]	92.0 [27.0]	88.6 [26.0]	91.6 [26.8]	88.4 [25.9]	85.2 [25.0]	87.6 [25.7]	84.5 [24.8]	81.4 [23.8]
		Sens BTUH [kW]	60.0 [17.6]	51.6 [15.1]	43.7 [15.1]	71.0 [20.8]	61.7 [18.1]	53.0 [18.1]	79.0 [23.1]	69.2 [20.3]	59.9 [20.3]
		Power	6.1	6.0	5.9	6.0	5.9	5.7	5.8	5.7	5.6
	85 [29.4]	Total BTUH [kW]	93.5 [27.4]	90.2 [26.4]	86.9 [25.5]	89.8 [26.3]	86.6 [25.4]	83.5 [24.5]	85.7 [25.1]	82.7 [24.2]	79.7 [23.4]
		Sens BTUH [kW]	59.5 [17.4]	51.1 [15.0]	43.3 [15.0]	70.4 [20.6]	61.2 [17.9]	52.7 [17.9]	78.4 [23.0]	68.7 [20.1]	59.6 [20.1]
		Power	6.4	6.2	6.1	6.2	6.1	6.0	6.1	6.0	5.9
	90 [32.2]	Total BTUH [kW]	91.5 [26.8]	88.3 [25.9]	85.1 [24.9]	87.8 [25.7]	84.7 [24.8]	81.6 [23.9]	83.8 [24.6]	80.8 [23.7]	77.9 [22.8]
		Sens BTUH [kW]	58.6 [17.2]	50.4 [14.8]	42.8 [14.8]	69.5 [20.4]	60.5 [17.7]	52.0 [17.7]	77.6 [22.7]	68.0 [19.9]	59.0 [19.9]
		Power	6.7	6.5	6.4	6.5	6.4	6.3	6.4	6.3	6.2
	95 [35]	Total BTUH [kW]	89.4 [26.2]	86.3 [25.3]	83.1 [24.3]	85.7 [25.1]	82.7 [24.2]	79.7 [23.4]	81.7 [23.9]	78.8 [23.1]	75.9 [22.2]
		Sens BTUH [kW]	57.6 [16.9]	49.6 [14.5]	42.1 [14.5]	68.6 [20.1]	59.7 [17.5]	51.4 [17.5]	76.6 [22.4]	67.2 [19.7]	58.3 [19.7]
		Power	7.0	6.9	6.7	6.9	6.7	6.6	6.7	6.6	6.5
	100 [37.8]	Total BTUH [kW]	87.2 [25.5]	84.1 [24.6]	81.1 [23.8]	83.5 [24.5]	80.5 [23.6]	77.6 [22.7]	79.4 [23.3]	76.6 [22.4]	73.8 [21.6]
		Sens BTUH [kW]	56.4 [16.5]	48.5 [14.2]	41.3 [14.2]	67.3 [19.7]	58.6 [17.2]	50.5 [17.2]	75.3 [22.1]	66.1 [19.4]	57.4 [19.4]
		Power	7.3	7.2	7.1	7.2	7.1	6.9	7.1	6.9	6.8
	105 [40.6]	Total BTUH [kW]	84.8 [24.8]	81.8 [24.0]	78.8 [23.1]	81.1 [23.8]	78.2 [22.9]	75.4 [22.1]	77.0 [22.6]	74.3 [21.8]	71.6 [21.0]
		Sens BTUH [kW]	55.0 [16.1]	47.3 [13.9]	40.2 [13.9]	65.9 [19.3]	57.4 [16.8]	49.5 [16.8]	73.8 [21.6]	64.8 [19.0]	56.3 [19.0]
		Power	7.7	7.5	7.4	7.5	7.4	7.3	7.4	7.3	7.2
	110 [43.3]	Total BTUH [kW]	82.3 [24.1]	79.4 [23.3]	76.5 [22.4]	78.5 [23.0]	75.8 [22.2]	73.0 [21.4]	74.5 [21.8]	71.9 [21.1]	69.3 [20.3]
		Sens BTUH [kW]	53.2 [15.6]	45.8 [13.4]	38.9 [13.4]	64.1 [18.8]	55.9 [16.4]	48.1 [16.4]	72.2 [21.2]	63.4 [18.6]	55.1 [18.6]
		Power	8.0	7.9	7.8	7.9	7.8	7.6	7.8	7.6	7.5
	115 [46.1]	Total BTUH [kW]	79.6 [23.3]	76.8 [22.5]	74.0 [21.7]	75.9 [22.2]	73.2 [21.4]	70.6 [20.7]	71.8 [21.0]	69.3 [20.3]	66.8 [19.6]
		Sens BTUH [kW]	51.3 [15.0]	44.1 [12.9]	37.4 [12.9]	62.2 [18.2]	54.2 [15.9]	46.8 [15.9]	70.2 [20.6]	61.7 [18.1]	53.7 [18.1]
		Power	8.4	8.3	8.1	8.3	8.2	8.0	8.2	8.0	7.9
	120 [48.9]	Total BTUH [kW]	76.8 [22.5]	74.1 [21.7]	71.4 [20.9]	73.1 [21.4]	70.5 [20.7]	68.0 [19.9]	69.0 [20.2]	66.6 [19.5]	64.2 [18.8]
		Sens BTUH [kW]	49.2 [14.4]	42.3 [12.4]	35.9 [12.4]	60.1 [17.6]	52.4 [15.4]	45.2 [15.4]	68.1 [20.0]	59.9 [17.6]	52.1 [17.6]
		Power	8.8	8.7	8.5	8.7	8.5	8.4	8.6	8.4	8.3

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—KW input

NOTES:

① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.

③ Power input is gross, which does not include indoor blower motor.

④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING
UNIT

SAWL-090VAZ

WITH
COOLING
COIL

SHGL-090N

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①										
wbE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]		3360 [1586]	2800 [1322]	2240 [1057]	3360 [1586]	2800 [1322]	2240 [1057]	3360 [1586]	2800 [1322]	2240 [1057]
DR ①		.09	.13	.19	.09	.13	.19	.09	.13	.19
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power 106.7 [31.3] 65.9 [19.3] 6.2	103.0 [30.2] 56.6 [16.6] 6.1	99.2 [29.1] 47.9 [16.6] 6.0	102.6 [30.1] 78.3 [22.9] 6.1	99.0 [29.0] 68.0 [19.9] 6.0	95.4 [28.0] 58.4 [19.9] 5.9	96.9 [28.4] 86.2 [25.3] 5.9	93.5 [27.4] 75.4 [22.1] 5.8	90.1 [26.4] 65.3 [22.1] 5.7
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power 105.6 [30.9] 66.0 [19.3] 6.5	101.8 [29.8] 56.6 [16.6] 6.4	98.1 [28.7] 48.0 [16.6] 6.3	101.4 [29.7] 78.3 [22.9] 6.4	97.8 [28.7] 68.0 [19.9] 6.3	94.3 [27.6] 58.5 [19.9] 6.2	95.8 [28.1] 86.4 [25.3] 6.3	92.4 [27.1] 75.6 [22.2] 6.2	89.0 [26.1] 65.5 [22.2] 6.0
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power 104.0 [30.5] 65.7 [19.2] 6.9	100.4 [29.4] 56.5 [16.6] 6.8	96.7 [28.3] 47.9 [16.6] 6.6	99.9 [29.3] 78.1 [22.9] 6.7	96.4 [28.2] 67.9 [19.9] 6.6	92.9 [27.2] 58.4 [19.9] 6.5	94.2 [27.6] 85.9 [25.2] 6.6	90.9 [26.6] 75.3 [22.1] 6.5	87.6 [25.7] 65.3 [22.1] 6.4
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power 102.1 [29.9] 64.9 [19.0] 7.2	98.6 [28.9] 55.9 [16.4] 7.1	95.0 [27.8] 47.4 [16.4] 7.0	98.0 [28.7] 77.3 [22.6] 7.1	94.5 [27.7] 67.2 [19.7] 7.0	91.1 [26.7] 57.8 [19.7] 6.9	92.3 [27.0] 85.3 [25.0] 7.0	89.1 [26.1] 74.8 [21.9] 6.8	85.9 [25.2] 64.9 [21.9] 6.7
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power 99.9 [29.3] 64.0 [18.8] 7.6	96.4 [28.2] 55.0 [16.1] 7.5	92.9 [27.2] 46.7 [16.1] 7.3	95.7 [28.0] 76.2 [22.3] 7.5	92.4 [27.1] 66.4 [19.5] 7.3	89.0 [26.1] 57.1 [19.5] 7.2	90.1 [26.4] 84.3 [24.7] 7.3	86.9 [25.5] 73.9 [21.7] 7.2	83.8 [24.6] 64.2 [21.7] 7.1
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power 97.3 [28.5] 62.5 [18.3] 8.0	93.8 [27.5] 53.7 [15.7] 7.9	90.4 [26.5] 45.6 [15.7] 7.7	93.1 [27.3] 74.8 [21.9] 7.9	89.8 [26.3] 65.1 [19.1] 7.7	86.6 [25.4] 56.1 [19.1] 7.6	87.4 [25.6] 82.7 [24.2] 7.7	84.4 [24.7] 72.6 [21.3] 7.6	81.3 [23.8] 63.0 [21.3] 7.5
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power 94.3 [27.6] 60.7 [17.8] 8.4	91.0 [26.7] 52.2 [15.3] 8.3	87.6 [25.7] 44.2 [15.3] 8.1	90.1 [26.4] 72.9 [21.4] 8.3	86.9 [25.5] 63.5 [18.6] 8.1	83.8 [24.6] 54.8 [18.6] 8.0	84.5 [24.8] 80.9 [23.7] 8.2	81.5 [23.9] 71.0 [20.8] 8.0	78.5 [23.0] 61.7 [20.8] 7.9
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power 90.9 [26.6] 58.4 [17.1] 8.9	87.7 [25.7] 50.2 [14.7] 8.7	84.5 [24.8] 42.6 [14.7] 8.6	86.7 [25.4] 70.6 [20.7] 8.7	83.7 [24.5] 61.6 [18.0] 8.6	80.7 [23.6] 53.1 [18.0] 8.4	81.1 [23.8] 78.7 [23.1] 8.6	78.3 [22.9] 69.2 [20.3] 8.4	75.4 [22.1] 60.1 [20.3] 8.3
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power 87.2 [25.5] 55.8 [16.3] 9.3	84.1 [24.6] 47.9 [14.0] 9.2	81.1 [23.8] 40.7 [14.0] 9.0	83.0 [24.3] 68.0 [19.9] 9.2	80.1 [23.5] 59.3 [17.4] 9.0	77.2 [22.6] 51.1 [17.4] 8.9	77.4 [22.7] 76.1 [22.3] 9.1	74.7 [21.9] 66.9 [19.6] 8.9	71.9 [21.1] 58.1 [19.6] 8.7
	120 [48.9]	Total BTUH [kW] Sens BTUH [kW] Power 83.1 [24.3] 52.8 [15.5] 9.8	80.2 [23.5] 45.4 [13.3] 9.6	77.3 [22.6] 38.5 [13.3] 9.5	78.9 [23.1] 65.1 [19.1] 9.7	76.2 [22.3] 56.8 [16.6] 9.5	73.4 [21.5] 49.0 [16.6] 9.3	73.3 [21.5] 73.0 [21.4] 9.5	70.7 [20.7] 64.2 [18.8] 9.4	68.1 [20.0] 55.9 [18.8] 9.2

DR —Depression ratio

dbE —Entering air dry bulb

wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH

Sens —Sensible capacity x 1000 BTUH

Power—KW input

NOTES:

- ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.
- ② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.
- ③ Power input is gross, which does not include indoor blower motor.
- ④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA

CONDENSING UNIT **SAWL-090VAZ** WITH COOLING COIL **SHGL-120N**

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			3360 [1586]	2800 [1322]	2240 [1057]	3360 [1586]	2800 [1322]	2240 [1057]	3360 [1586]	2800 [1322]	2240 [1057]
DR ①			.06	.11	.18	.06	.11	.18	.06	.11	.18
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	108.8 [31.9]	105.0 [30.8]	101.2 [29.7]	104.6 [30.6]	101.0 [29.6]	97.3 [28.5]	99.0 [29.0]	95.5 [28.0]	92.0 [27.0]
		Sens BTUH [kW]	67.7 [19.8]	58.1 [17.0]	49.2 [17.0]	79.9 [23.4]	69.5 [20.4]	59.7 [20.4]	87.9 [25.8]	76.9 [22.5]	66.5 [22.5]
		Power	6.4	6.3	6.2	6.3	6.2	6.1	6.1	6.0	5.9
	80 [26.7]	Total BTUH [kW]	107.6 [31.5]	103.8 [30.4]	100.1 [29.3]	103.5 [30.3]	99.8 [29.2]	96.2 [28.2]	97.8 [28.7]	94.4 [27.7]	91.0 [26.7]
		Sens BTUH [kW]	67.7 [19.8]	58.1 [17.0]	49.3 [17.0]	80.0 [23.4]	69.5 [20.4]	59.7 [20.4]	88.0 [25.8]	77.1 [22.6]	66.8 [22.6]
		Power	6.7	6.6	6.5	6.6	6.5	6.4	6.4	6.3	6.2
	85 [29.4]	Total BTUH [kW]	106.1 [31.1]	102.4 [30.0]	98.7 [28.9]	101.9 [29.9]	98.4 [28.8]	94.8 [27.8]	96.3 [28.2]	92.9 [27.2]	89.5 [26.2]
		Sens BTUH [kW]	67.5 [19.8]	58.0 [17.0]	49.2 [17.0]	79.7 [23.4]	69.4 [20.3]	59.7 [20.3]	87.7 [25.7]	76.8 [22.5]	66.5 [22.5]
		Power	7.1	6.9	6.8	6.9	6.8	6.7	6.8	6.7	6.5
	90 [32.2]	Total BTUH [kW]	104.2 [30.5]	100.6 [29.5]	96.9 [28.4]	100.0 [29.3]	96.5 [28.3]	93.0 [27.2]	94.4 [27.7]	91.1 [26.7]	87.8 [25.7]
		Sens BTUH [kW]	66.7 [19.5]	57.4 [16.8]	48.7 [16.8]	78.9 [23.1]	68.7 [20.1]	59.1 [20.1]	87.0 [25.5]	76.3 [22.4]	66.2 [22.4]
		Power	7.4	7.3	7.2	7.3	7.2	7.0	7.1	7.0	6.9
	95 [35]	Total BTUH [kW]	101.9 [29.9]	98.4 [28.8]	94.8 [27.8]	97.8 [28.7]	94.4 [27.7]	90.9 [26.6]	92.1 [27.0]	88.9 [26.0]	85.7 [25.1]
		Sens BTUH [kW]	65.6 [19.2]	56.5 [16.6]	48.0 [16.6]	78.0 [22.9]	67.9 [19.9]	58.4 [19.9]	85.9 [25.2]	75.4 [22.1]	65.5 [22.1]
		Power	7.8	7.7	7.5	7.7	7.5	7.4	7.5	7.4	7.3
	100 [37.8]	Total BTUH [kW]	99.3 [29.1]	95.8 [28.1]	92.4 [27.1]	95.2 [27.9]	91.8 [26.9]	88.5 [25.9]	89.5 [26.2]	86.4 [25.3]	83.2 [24.4]
		Sens BTUH [kW]	64.2 [18.8]	55.2 [16.2]	47.0 [16.2]	76.5 [22.4]	66.6 [19.5]	57.4 [19.5]	84.4 [24.7]	74.1 [21.7]	64.3 [21.7]
		Power	8.2	8.1	7.9	8.1	7.9	7.8	7.9	7.8	7.6
	105 [40.6]	Total BTUH [kW]	96.3 [28.2]	93.0 [27.2]	89.6 [26.3]	92.2 [27.0]	88.9 [26.0]	85.7 [25.1]	86.5 [25.3]	83.5 [24.5]	80.5 [23.6]
		Sens BTUH [kW]	62.3 [18.3]	53.7 [15.7]	45.6 [15.7]	74.7 [21.9]	65.0 [19.0]	56.0 [19.0]	82.5 [24.2]	72.5 [21.2]	63.0 [21.2]
		Power	8.6	8.5	8.3	8.5	8.3	8.2	8.3	8.2	8.0
	110 [43.3]	Total BTUH [kW]	93.0 [27.2]	89.7 [26.3]	86.5 [25.3]	88.8 [26.0]	85.7 [25.1]	82.6 [24.2]	83.2 [24.4]	80.3 [23.5]	77.3 [22.6]
		Sens BTUH [kW]	60.1 [17.6]	51.7 [15.1]	44.0 [15.1]	72.4 [21.2]	63.1 [18.5]	54.4 [18.5]	80.5 [23.6]	70.7 [20.7]	61.4 [20.7]
		Power	9.1	8.9	8.7	8.9	8.8	8.6	8.8	8.6	8.5
	115 [46.1]	Total BTUH [kW]	89.3 [26.2]	86.1 [25.2]	83.0 [24.3]	85.1 [24.9]	82.1 [24.1]	79.1 [23.2]	79.5 [23.3]	76.7 [22.5]	73.9 [21.7]
		Sens BTUH [kW]	57.5 [16.8]	49.4 [14.5]	42.0 [14.5]	69.8 [20.5]	60.8 [17.8]	52.4 [17.8]	77.8 [22.8]	68.4 [20.0]	59.5 [20.0]
		Power	9.5	9.3	9.2	9.4	9.2	9.0	9.2	9.1	8.9
	120 [48.9]	Total BTUH [kW]	85.2 [25.0]	82.2 [24.1]	79.2 [23.2]	81.0 [23.7]	78.2 [22.9]	75.3 [22.1]	75.4 [22.1]	72.7 [21.3]	70.1 [20.5]
		Sens BTUH [kW]	54.6 [16.0]	46.9 [13.7]	39.8 [13.7]	66.8 [19.6]	58.3 [17.1]	50.2 [17.1]	74.8 [21.9]	65.7 [19.2]	57.2 [19.2]
		Power	10.0	9.8	9.6	9.9	9.7	9.5	9.7	9.5	9.4

DR —Depression ratio
dbE —Entering air dry bulb
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power—KW input

[] Designates Metric Conversions

NOTES:

- ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].
- ② Total and sensible capacity is gross, with no deduction for indoor blower motor heat.
- ③ Power input is gross, which does not include indoor blower motor.
- ④ Refer to the "Systems Selection Performance Program and Data Diskette" to interpolate or extrapolate above data.

TYPICAL REFRIGERANT PIPING RECOMMENDATIONS

General Notes:

- 1. Vertical risers not to exceed 60 feet [18.29 m].
- 2. Locate the condensing unit and evaporator(s) as close together as possible to minimize piping runs.
- 3. Condensing units are shipped with a nitrogen holding charge. Evacuate condensing unit before charging with refrigerant.


EQUIVALENT LENGTH (FT.) [m] OF STRAIGHT TYPE "L" TUBING FOR NON-FERROUS VALVES AND FITTINGS (BRAZED)						
TUBE SIZE (IN.) [mm] O.D.	SOLENOID VALVE	ANGLE VALVE	SHORT RADIUS ELL	LONG RADIUS ELL	TEE LINE FLOW	TEE BRANCH FLOW
1/2 [12.7]	12 [3.7]	8.3 [2.5]	1.6 [0.5]	1.0 [0.3]	1.0 [0.3]	3.1 [0.9]
5/8 [15.88]	15 [4.6]	10.4 [3.2]	1.9 [0.6]	1.2 [0.4]	1.2 [0.4]	3.6 [1.1]
3/4 [19.05]	18 [5.5]	12.5 [3.8]	2.1 [0.7]	1.4 [0.4]	1.4 [0.4]	4.2 [1.3]
7/8 [22.23]	21 [6.9]	14.6 [4.4]	2.4 [0.7]	1.6 [0.5]	1.6 [0.5]	4.8 [1.5]
1 1/8 [28.58]		18.8 [5.7]	3.0 [0.9]	2.0 [0.6]	2.0 [0.6]	6.0 [1.8]
1 3/8 [34.93]		22.9 [7.0]	3.6 [1.1]	2.4 [0.7]	2.4 [0.7]	7.2 [2.2]
1 5/8 [41.28]		27.1 [8.3]	4.2 [1.3]	2.8 [0.8]	2.8 [0.8]	8.4 [2.6]
2 1/8 [53.98]		35.4 [10.8]	5.3 [1.6]	3.5 [1.1]	3.5 [1.1]	10.7 [3.3]

RECOMMENDED VAPOR AND LIQUID LINE SIZES FOR VARIOUS LENGTHS OF RUN				
LINEAR LENGTH (FT.) [m]	LIQUID LINE O.D. SIZES (IN.) [mm]		VAPOR LINE O.D. SIZES (IN.) [mm]	
	078	090*	078	090
0-15 [0-4.57]	1/2 [12.7]	1/2 [12.7]	1 1/8 [28.58]	1 1/8 [28.58]
16-50 [4.88-15.24]	1/2 [12.7]	1/2 [12.7]	1 1/8 [28.58]	1 1/8 [28.58]
51-100 [15.54-30.48]	1/2 [12.7]	1/2 [12.7]	1 1/8 [28.58]	1 3/8 [34.93]
101-150 [30.78-45.72]	1/2 [12.7]	1/2 [12.7]	1 3/8 [34.93]	1 3/8 [34.93]

NOTE: Runs between condenser and evaporator not to exceed 150' [45.7 m] linear length.


*See note ④ under liquid line pressure drop chart. Use 5/8" [15.88 mm] liquid line with solenoid valve.

LIQUID LINE PRESSURE DROP PER 100 FEET [30.48 m] EQUIVALENT LENGTH (TYPE L COPPER TUBING)

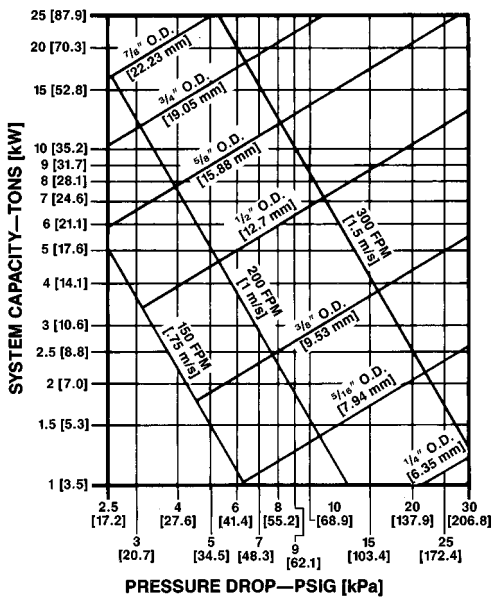

- NOTES:
- 1) When evaporator coil is above condenser, the pressure drop due to vertical lift (.5 PSIG per foot of lift) [1.05 kPa per meter] must be added to the pressure drop derived from this curve.
 - 2) Size liquid line for no more than 10°F [5.6°C] loss (approximately 50 PSIG [344.7 kPa] total pressure drop).
 - 3) Do not oversize liquid line. Oversized liquid lines add significantly to the amount of refrigerant required to charge the system.
 - 4) The maximum recommended velocity with solenoid valves or other quick closing devices in the liquid line is 300 FPM [1.5 m/s].

VAPOR LINE SYSTEM CAPACITY LOSS IN PERCENT PER 100 FEET [30.48 m] EQUIVALENT LENGTH (TYPE L COPPER TUBING)

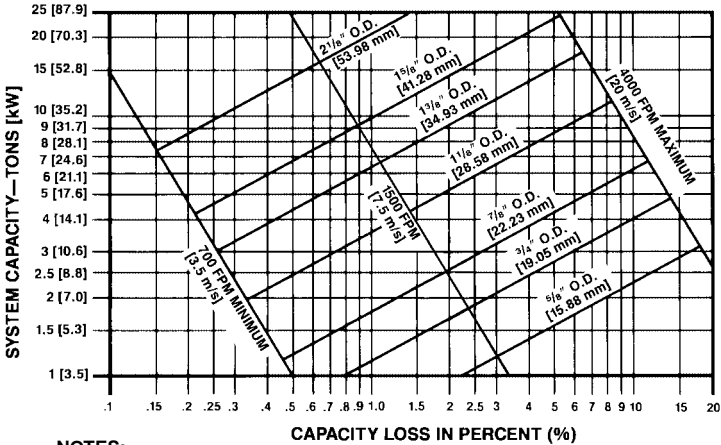


- NOTES:
- 1) The minimum velocity line (700 fpm) [3.6 m/s] is recommended.
 - 2) For vapor pressure drop (PSIG) [6.9 kPa], multiply percent (%) loss by 1.18.
 - 3) Size vapor lines for no more than 2°F [1.1°C] loss which corresponds to approximately 5 PSIG [34.4 kPa] pressure drop.
 - 4) Pitch all horizontal vapor lines downward in the direction of flow (1/2" [12.7 mm] to 10' [3.0 m] run).

WARNING

Do not use oxygen to purge lines or pressure system for leak test. Oxygen reacts violently with oil, which can cause an explosion resulting in severe personal injury or death.

COIL ABOVE CONDENSING UNIT

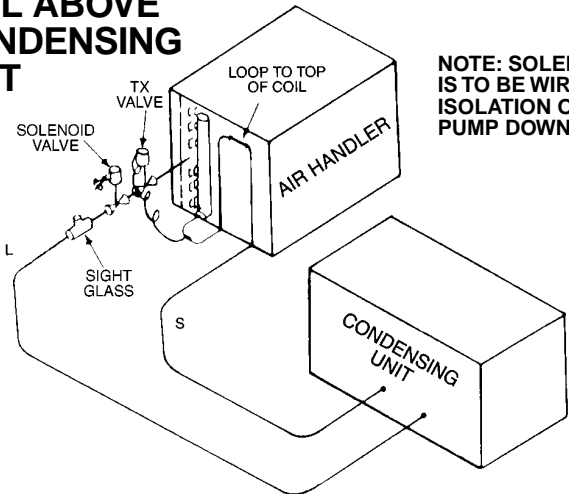

NOTE: SOLENOID VALVE IS TO BE WIRED FOR ISOLATION ONLY, NOT PUMP DOWN.

[] Designates Metric Conversions

TYPICAL REFRIGERANT PIPING RECOMMENDATIONS (cont.)

REQUIRED OZS. R-410A CHARGE PER FT. [m] OF TUBING

TUBE SIZE O.D. (IN.) [mm]	LIQUID (OZ.) [g]	VAPOR (OZ.) [g]
1/2 [12.7]	1.06 [30.0]	.04 [1.13]
5/8 [15.88]	1.65 [46.7]	.07 [1.98]
3/4 [19.05]	2.46 [69.7]	.10 [2.83]
7/8 [22.23]	3.28 [92.9]	.13 [3.68]
1 1/8 [28.58]		.22 [6.23]
1 3/8 [34.93]		.34 [9.63]
1 5/8 [41.28]		.48 [13.60]
2 1/8 [53.98]		.84 [23.81]


Quantities based on 110°F liquid and 45°F vapor.

GENERAL INSTALLATION

The condensing unit should be installed outdoors. It should be located as near as possible to the evaporator section to keep connecting refrigerant tubing lengths to a minimum. The unit must be installed to allow a free air flow to the condenser coils.

If several units are installed adjacent to each other, care must be taken to avoid recirculation of air from one condenser to another. In all installations, adequate space must be provided for installation and servicing.

CLEARANCES

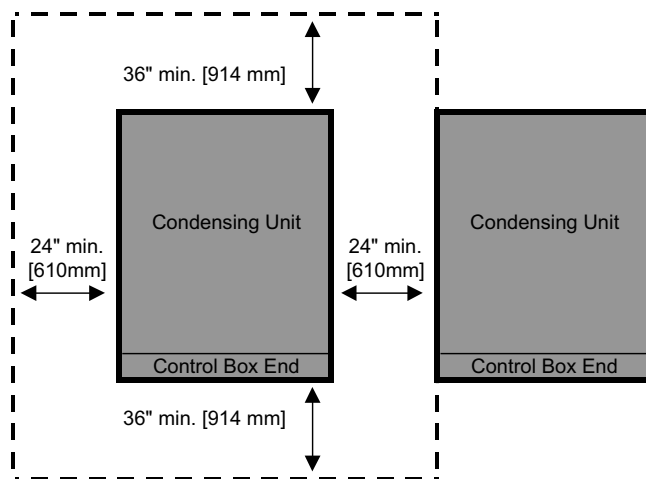

The unit must not be connected to any duct work. Do not locate unit under a roof drip; if necessary, install gutters, etc., to prevent water run-off from hitting the unit. To prevent air recirculation, it is recommended that the unit not be installed under an overhang, but if necessary **allow a minimum of 60 inches [1524 mm] above the unit for air discharge.**

ROOFTOP INSTALLATION

If rooftop installation is required, make certain that the building construction is adequate for the weight of the unit. (Refer to physical data chart.) Before placing the unit on the roof, make certain that the nylon rigging slings are of sufficient length to maintain equilibrium of the unit when lifting. Under no circumstances should the unit be lifted by only one corner for rooftop installation.


BASIC SYSTEM CHARGE*

UNIT MODEL	BASIC SYSTEM CHARGE, OZ, [g]*
SAWL-078	178 [5046]
SAWL-090	239 [6775]

*System with 0 feet [m] of tubing.

RIGGING

SAWL 078 & 090 MODELS

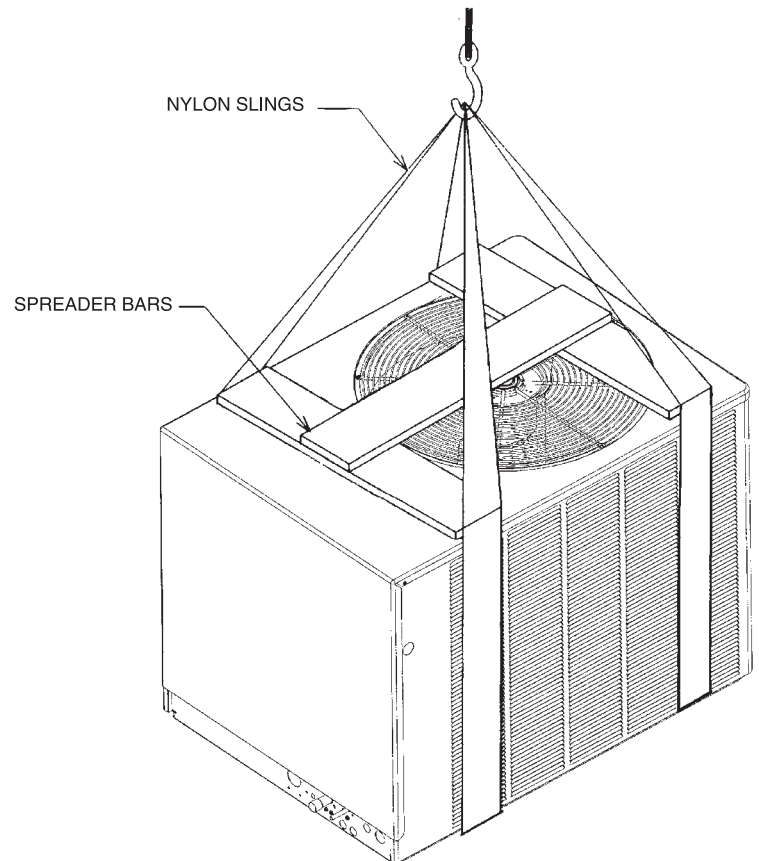


SLAB INSTALLATION


Condensing units should be set on a solid level foundation. When installed at ground level, the unit should be placed on a 6 inch [152.4 mm] cement slab. If the pad is formed at the installation site, do not pour the pad tight against the structure, otherwise vibration will be transmitted from the unit through the pad.

[] Designates Metric Conversions

TYPICAL WIRING SCHEMATIC

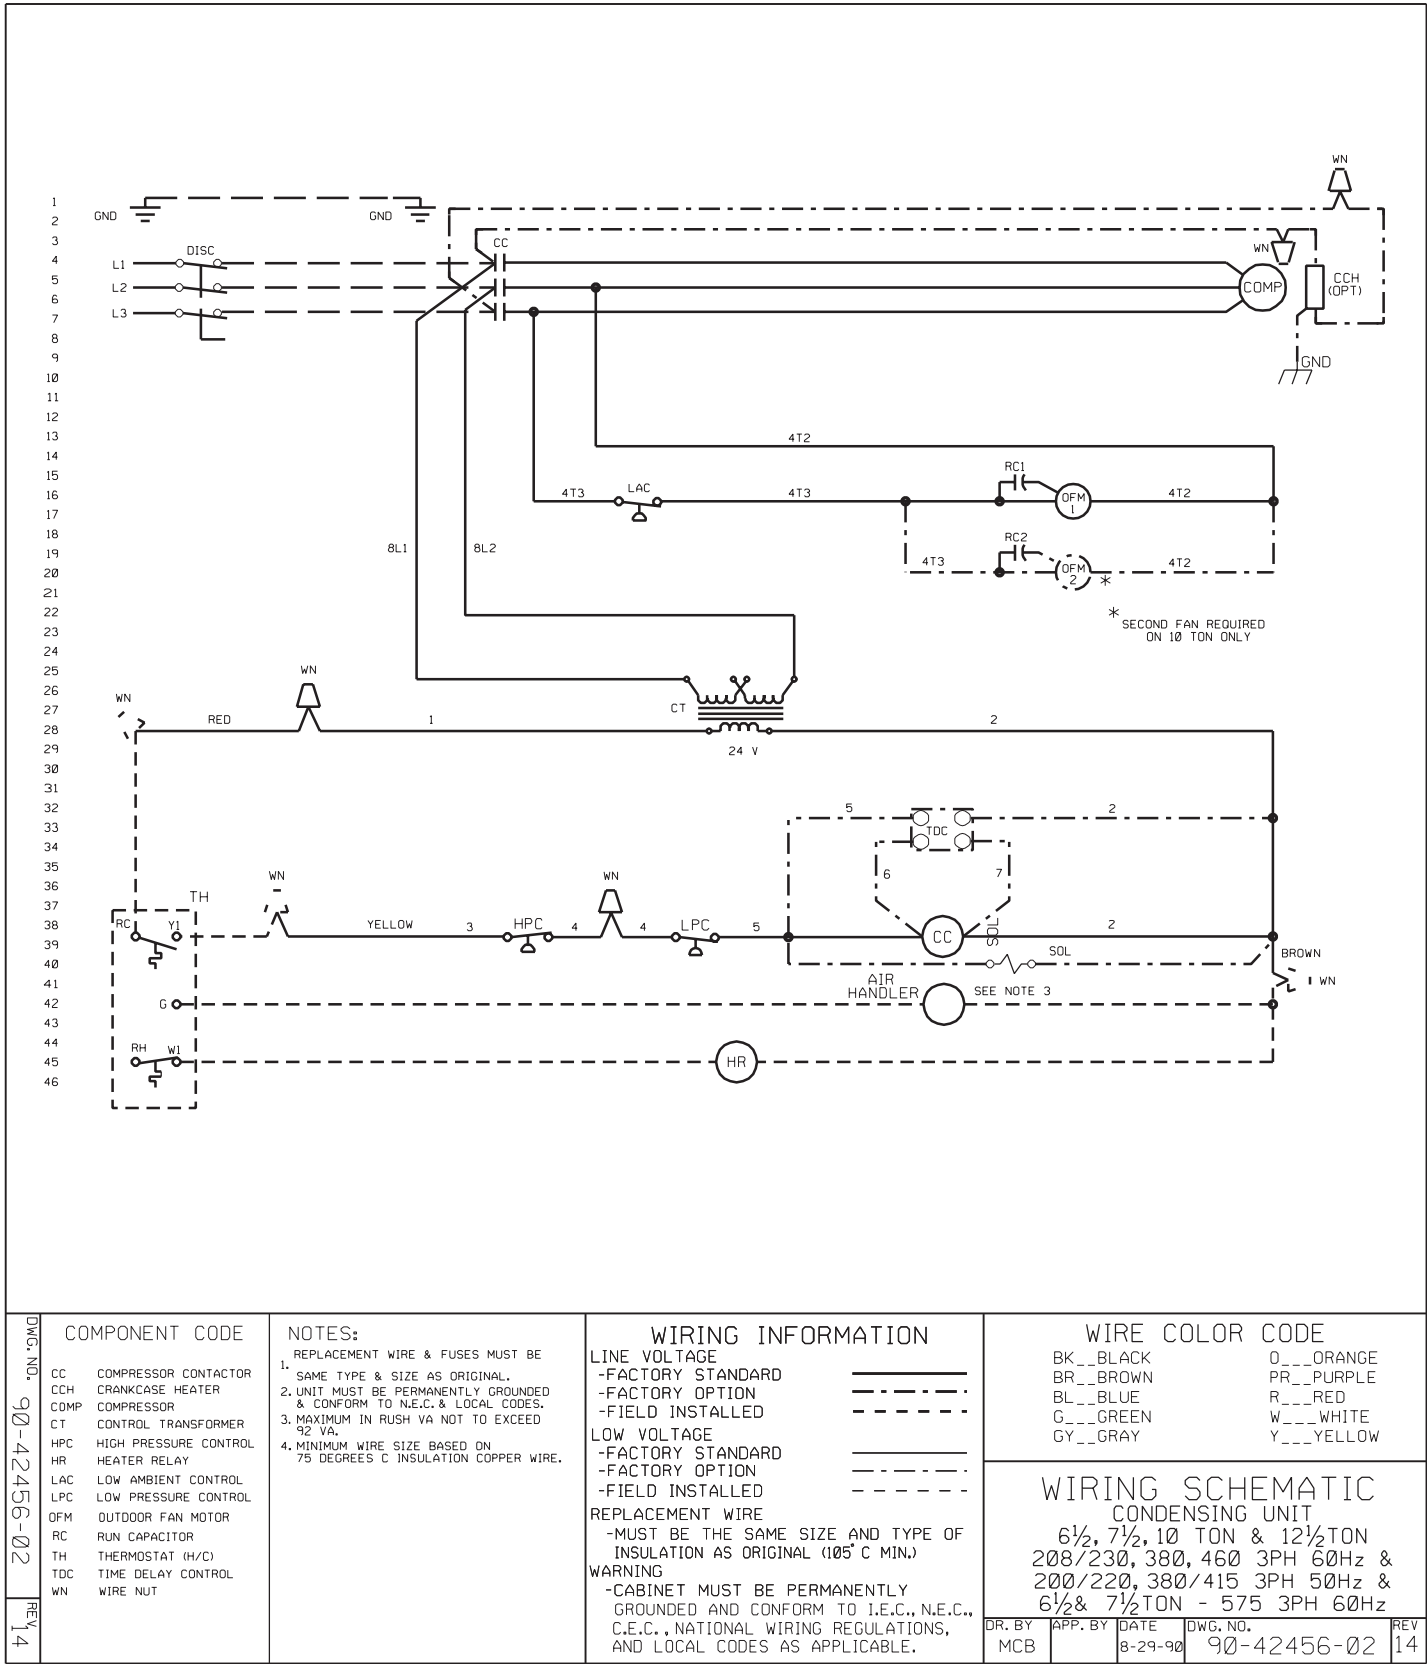

TYPICAL WIRING SCHEMATIC

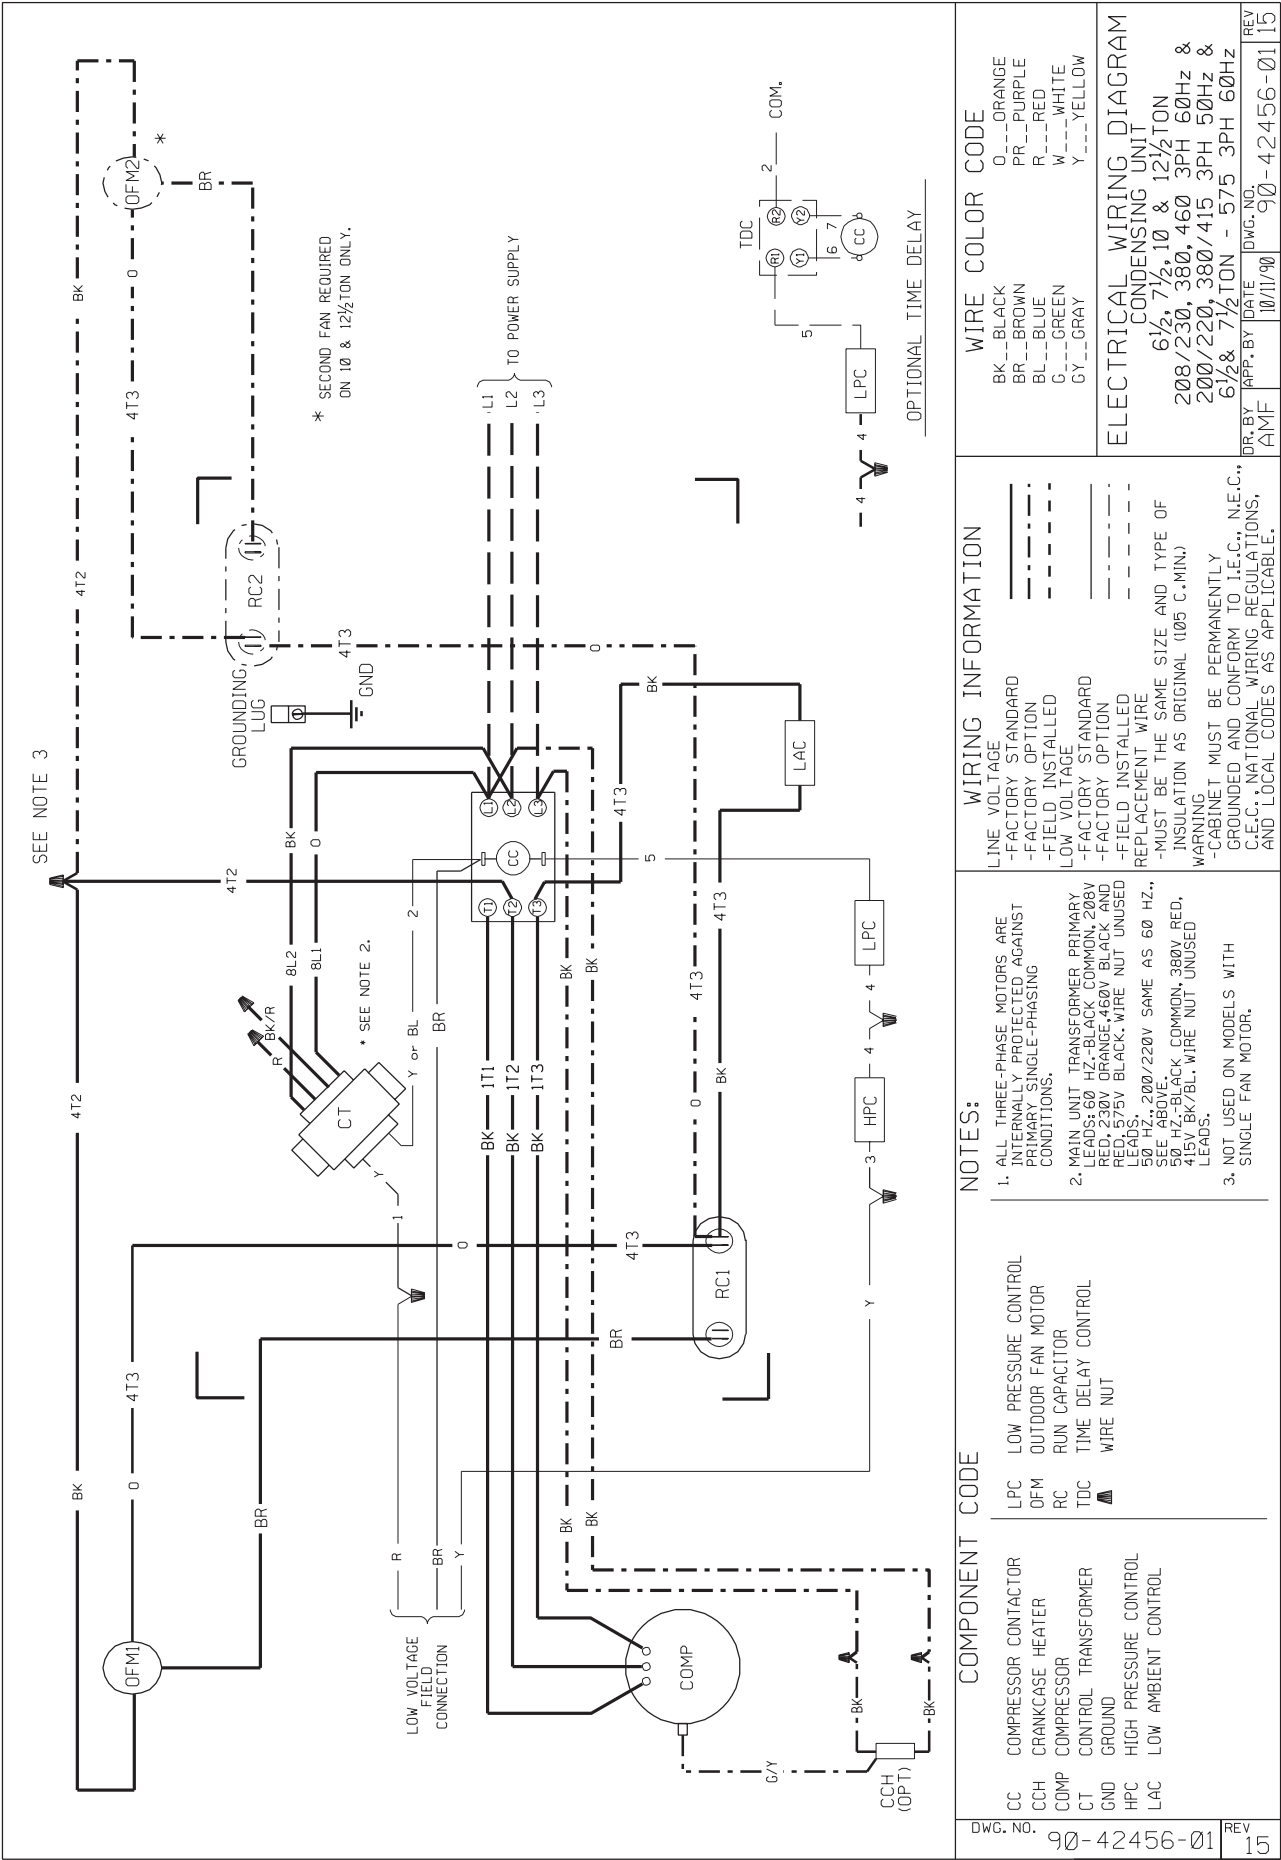

SEQUENCE OF OPERATION

1. When the room temperature is higher than the thermostat setting, the thermostat contacts close and energize the compressor contactor (CC) through the high pressure & low pressure control contacts. If the unit has "short cycled" and the optional time delay (TDC) has been supplied, the contactor coil (CC) will remain de-energized for up to five (5) minutes.
2. The system will continue cooling operation, as long as the contacts of all safety devices are closed and until the thermostat is satisfied.
3. When the thermostat is satisfied compressor or contactor (CC) is de-energized.

GUIDE SPECIFICATIONS

Furnish and install as shown on the drawing Rheem Model _____ air cooled condensing unit suitable for outdoor application.

COMPRESSOR—Unit shall have (1) compressor. It is to be of the welded hermetic type with durable insulation on the motor windings. It shall be externally mounted on rubber grommets to reduce vibration transmission and noise to surrounding area. Maximum power input shall not be more than _____ on 6.5 nominal ton [22.86 kW] units and _____ on 7.5 nominal ton [26.38 kW] units _____ at conditions specified.

LOW AMBIENT CONTROL—All units shall have standard head pressure controls that cycle the condenser fan motors to maintain condensing pressures for operation down to 0°F [°C] ambient.

CAPACITY—Capacity shall be _____ BTU/HR when operating at _____ °F [°C] saturated suction temperature.

MOTORS & FANS—Each unit shall have one permanently lubricated motor fixed with direct-drive, multi-bladed fan. Motor shall be equipped with inherent overload protection. Motor & fan shall be mounted on top panel for easy access. Condenser air shall discharge vertically.

COILS—Coils shall be fabricated of 3/8" [9.53 mm] O.D. seamless copper tubing and aluminum fins with die-formed collars mechanically bonded to tubes arranged in a staggered pattern. All coils shall be submitted to a pressure test after fabrication and dehydrated. Units shall be shipped with a dry nitrogen

holding charge. Coil design shall permit removal of service panels without affecting operation of the unit. Airflow shall be drawn through design providing uniform air distribution across the coil surface.

CASINGS—Casings shall make unit suitable for outdoor installation. Casing, base pan and framework shall be manufactured of galvanized sheet metal subjected to multistage cleaning, pre-treated and finished with a durable powder coat paint, capable of withstanding a 1000-HR salt spray test per ASTM B 117. Units shall have stamped louver panels offering 100% protection of the condenser coil face. Openings shall be provided for power. Dimensions of entire assembly shall be not more than _____ inches [mm] high, _____ inches [mm] long and _____ inches [mm] wide.

REFRIGERATION CIRCUIT—Shall include the compressor, the condenser coils, all internal refrigerant piping, a liquid line and suction line service valve. Refrigerant stubs shall be extended through the cabinet for external field connection without affecting accessibility to compressor compartment.

CONTROL PANEL—The panel shall be designed for single power source to the compressor and fan motor(s) and shall include low ambient fan cycling control, and compressor contactor.

SAFETY CONTROLS—Manual reset high pressure and automatic reset low pressure control shall be provided.

FACTORY TESTING—All units shall be test run at the factory.

[] Designates Metric Conversions

NOTES

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

**Rheem Heating,
Cooling and
Water Heating**

P.O. Box 17010, Fort Smith, AR 72917



"In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice."